



11815 NE 99th Street, Suite 1294  
Vancouver, WA 98662  
Voice: 360-574-3058  
Fax: 360-576-0925  
Web: <https://www.swcleanair.gov>  
Email: [Tina@swcleanair.gov](mailto:Tina@swcleanair.gov)

## Notice of Intent to Remove Asbestos

Case #: 25-005

Amendment: 0

Date Received: 1/2/2025

Date Paid: 1/2/2025

SWCAA Fee: \$765.00

Receipt #: 168643188

**This notification MUST be present at all times at the asbestos project sit**

Quantity to be removed: 9895 Square Feet 0 Linear Feet

Workshift days: M T W Th F

Project starting date: 1/20/2025 Project Completion date: 2/28/2025

Workshift hours: 8:00am-4:30pm

Site Name: Date park Condominiums

Site address: 3701 & 3701 1/2 E 18th St

Location of Asbestos: Throughout units

City/State/Zip: Vancouver

WA

98661

☒ Demolition of Structure (Notification of Demolition required)

County: CLARK COUNTY

☒ Asbestos survey conducted?

No survey reason:

AHERA Inspector: Kyler Spears

Certification #: 192139

### Material to be Removed:

- |                                       |   |                              |   |  |   |
|---------------------------------------|---|------------------------------|---|--|---|
| <input type="checkbox"/> Fireproofing | <input checked="" type="checkbox"/> Popcorn Ceiling | <input type="checkbox"/> CAB | <input checked="" type="checkbox"/> Sheet Vinyl | <input type="checkbox"/> Boiler Insulation | <input checked="" type="checkbox"/> Duct Tape |
| <input type="checkbox"/> Duct Paper   | <input type="checkbox"/> Mag Pipe Insulation        |                              | <input type="checkbox"/> Air Cell               | <input type="checkbox"/> CA Pipe           | <input type="checkbox"/> VAT                  |
| <input type="checkbox"/> Other        |   |                              |   |  |   |

### Control Methods:

- |   |                                    |   |                                       |   |  |
|---|------------------------------------|---|---------------------------------------|---|--|
| <input checked="" type="checkbox"/> N.P Enclosure | <input type="checkbox"/> Glove Bag | <input type="checkbox"/> Mini Enclosure | <input type="checkbox"/> Wrap and Cut | <input checked="" type="checkbox"/> Water | <input checked="" type="checkbox"/> HEPA Vac |
| <input checked="" type="checkbox"/> Other         | Regulate Areas                     |   |                                       |   |  |

Asbestos Contractor: Minority Abatement Contractors, Inc.

Phone: 360-750-1900

Mailing Address: 3200 NE 65th St, Vancouver, WA, 98663

Email: [vwhitebird@minorityac.com](mailto:vwhitebird@minorityac.com)

Certification ##: ABCN00001346

Supervisor: Jesus Ortiz

Phone: 360-605-7958

Property Owner: Ashni Prasad

Phone: 360-600-3142

Mailing Address: 6315 SE Evergreen Hwy, Vancouver WA 98661

Asbestos Disposal Site: Wasco County Landfill: 2550 Steele Rd, The Dalles, OR, 97058-

**I DO HEREBY CERTIFY THAT THE INFORMATION CONTAINED IN THIS NOTIFICATION IS,  
TO THE BEST OF MY KNOWLEDGE, ACCURATE AND COMPLETE.**

Submitter Name: Guillermo Plaza

Representing: Minority Abatement Contract

Submitter Title: Project manager

Date Submitted: 1/2/2025

Reviewed by SWCAA: Danielle Kreps

*Danielle Kreps*

☒ Approved



11815 NE 99th Street, Suite 1294  
Vancouver, WA 98662  
Voice: 360-574-3058  
Fax: 360-576-0925  
Web: <https://www.swcleanair.gov>  
Email: [Tina@swcleanair.gov](mailto:Tina@swcleanair.gov)

## Notice of Intent to Remove Asbestos

Case #: 25-005

Amendment: 0

Date Received: 1/2/2025

Date Paid: 1/2/2025

SWCAA Fee: \$765.00

Receipt #: 168643188

**This notification MUST be present at all times at the asbestos project sit**

# **ASBESTOS SURVEY**

For the house located at:

**3701 EAST 18<sup>TH</sup> STREET  
VANCOUVER, WASHINGTON**

Prepared for:  
Date Park Condominium, Inc.

**CERTIFIED ENVIRONMENTAL CONSULTING, LLC  
615 SE CHKALOV DRIVE SUITE 12  
VANCOUVER, WASHINGTON 98683-5280**

**Prepared by:  
Don Young  
Kyler Spears  
Eric S. Viken**

**EXECUTIVE SUMMARY**

Dear Ms. Prasad:

Enclosed are the results of the asbestos survey report conducted by C.E.C., LLC, for the house located at, 3701 East 18<sup>th</sup> Street, in Vancouver, Washington for demolition purposes. This survey was coordinated with you and conducted on October 1, 2024, by Kyler Spears, Don Young, and Eric S. Viken, AHERA certified inspectors.

All samples were taken in a random manner as required by EPA AHERA rules and analyzed using polarized light microscopy with dispersion staining according to EPA and OR-OSHA Methodology. The samples were analyzed in C.E.C., LLC's laboratory at, 615 SE Chkalov Drive Suite #12, in Vancouver, Washington. As the asbestos samples were analyzed in our laboratory, the analytical data enclosed is the analysis report.

**Asbestos was identified in the white duct tape (See sample data sheet attached). Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

The following survey is divided into the following sections:


- ◇ Summary sheet - details the type and construction of the building with approximate amounts of asbestos in the building.
- ◇ Sample result sheet - contains sample numbers and results, description of materials and homogeneous areas of material.
- ◇ Assessment of materials - contains an assessment of asbestos materials.
- ◇ Response actions recommended - contains the response actions we recommend.
- ◇ Laboratory analysis sheet - contains the results of our laboratory analysis.
- ◇ Inspector's certifications.
- ◇ Photographic log.
- ◇ Asbestos chain of custody form (survey report form).

C.E.C. has investigated accessible and inaccessible areas of this facility in locating suspect ACM using destructive sampling including the interior and exterior. The current extent and condition of the ACM was detected through on-site observation and physical determination.

NOTE: This asbestos survey report is available to Date Park Condominium, Inc., and not to be reproduced in total or part without written consent of Date Park Condominium, Inc.

We appreciate the opportunity to have worked with you. If you have any questions or if we can be of any further service, please contact our office.

Sincerely,



Don Young  
Principal



**SUMMARY SHEET**

**Owner or Representative:** Asha Prasad

**Address:** House at, 3701 East 18<sup>th</sup> Street

**City:** Vancouver      **State:** Washington

**Owner's Representative:**    Date Park Condominium, Inc.  
   Ms. Asha Prasad  
   6315 SE Evergreen Hwy  
   Vancouver, Washington 98661-7628

**Owner/Rep. Telephone Number:** (360) 600-3142

**Surveyed by:** Kyler Spears-Accreditation Number: 192139  
                         Don Young-Accreditation Number: 194365  
                         Eric S. Viken-Accreditation Number: 192140

**CONSTRUCTION DATA:**

**Year Built:** Approx.: 1950's                      **Size:** Approx. 2,132 SQ FT

**Construction Type:** Wood, Metal, Concrete

**Number of Floors:** 2 with Basement

**Current/Past Use:** Residential/Residential

**Roof Construction:** Asphalt Shingle

**Heating System:** Furnace

**Attic Insulation:** Fiberglass

**Pipe Insulation:** Non-Insulated

**SUMMARY DATA****HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

PRODUCT	FUNCTIONAL SPACE	AMOUNT	FRIABLE	CONDITION	SAMPLE #	RESULTS
WHITE DUCT TAPE	BASEMENT DUCTWORK, SELECTIVE THROUGHOUT	APPROX. 200 LF	YES	GOOD	27	55% CHRYSOTILE

Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.

Certified Environmental Consulting, LLC, warrants that the findings contained herein have been prepared in general accordance with accepted professional practices as applied by similar professionals in the community at the time of this report preparation. Changes in the state of the art or in applicable regulations cannot be anticipated and have not been addressed in this report. The field and laboratory results reported herein are considered sufficient in detail and scope to determine presence of asbestos containing materials in or around the area(s) requested at the time of the inspection. Test results are valid only for the materials tested.

There is a distinct possibility that conditions may exist that could not be identified within the scope of the inspection or that were not apparent during the site visit. This inspection covered only those areas that were exposed or physically accessible to the inspector. The inspection is limited to the information available from the client at the time of the inspection was conducted.

**SAMPLE RESULTS****HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
1	GRAY/BLACK ASPHALT SHINGLE	TOP LAYER ROOF	ENTIRE ROOF	NONE DETECTED
2	GRAY/BLACK ASPHALT SHINGLE	SECOND LAYER ROOF	ENTIRE ROOF	NONE DETECTED
3	GRAY/BLACK ASPHALT SHINGLE	THIRD LAYER ROOF	ENTIRE ROOF	NONE DETECTED
4	BLACK TAR PAPER	BOTTOM LAYER ROOF	ENTIRE ROOF	NONE DETECTED
5	RED BRICK AND GRAY MORTAR	CHIMNEY		NONE DETECTED
6	WHITE WINDOW GLAZING COMPOUND	EXTERIOR WINDOW	APPROX. 15 EACH	NONE DETECTED
7	BLACK TAR PAPER	UNDER EXTERIOR SIDING	THROUGHOUT	NONE DETECTED
8	WHITE SHEET VINYL	UNDER PERGO FLOORING FRONT ENTRY		NONE DETECTED
9	GRAY PLASTER	FRONT ENTRY	SELECTIVE THROUGHOUT	NONE DETECTED
10	GRAY PLASTER	LIVING ROOM	SELECTIVE THROUGHOUT	NONE DETECTED
11	GRAY PLASTER	DINING ROOM	SELECTIVE THROUGHOUT	NONE DETECTED
12	WHITE WALL TEXTURE	FRONT ENTRY	THROUGHOUT	NONE DETECTED
13	WHITE WALL TEXTURE	HALLWAY	THROUGHOUT	NONE DETECTED
14	WHITE WALL TEXTURE	KITCHEN	THROUGHOUT	NONE DETECTED
15	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY	SELECTIVE THROUGHOUT	NONE DETECTED
16	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	HALLWAY	SELECTIVE THROUGHOUT	NONE DETECTED
17	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN	SELECTIVE THROUGHOUT	NONE DETECTED



**SAMPLE RESULTS****HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
18	WHITE CEILING TEXTURE	FRONT ENTRY	SELECTIVE THROUGHOUT	NONE DETECTED
19	WHITE CEILING TEXTURE	HALLWAY	SELECTIVE THROUGHOUT	NONE DETECTED
20	WHITE CEILING TEXTURE	KITCHEN	SELECTIVE THROUGHOUT	NONE DETECTED
21	TAN CERAMIC TILE WITH GROUT	AS COUNTERTOP KITCHEN	TOP LAYER BATHROOM FLOOR	NONE DETECTED
22	WHITE SKIM COAT	LIVING ROOM	KITCHEN, DINING ROOM	NONE DETECTED
23	WHITE SKIM COAT	KITCHEN	LIVING ROOM, DINING ROOM	NONE DETECTED
24	WHITE SKIM COAT	DINING ROOM	LIVING ROOM, KITCHEN	NONE DETECTED
25	BLACK VAPOR BARRIER	UNDER PERGO FLOORING KITCHEN		NONE DETECTED
26	GRAY BACKERBOARD	SECOND LAYER KITCHEN		NONE DETECTED
27	WHITE DUCT TAPE	BASEMENT DUCTWORK	SELECTIVE THROUGHOUT	<b>55% CHRYSOTILE</b>
28	WHITE WALL TEXTURE	BACK BEDROOM	THROUGHOUT	NONE DETECTED
29	WHITE WALL TEXTURE	BACK BEDROOM	THROUGHOUT	NONE DETECTED
30	WHITE WALL TEXTURE	BASEMENT BEDROOM	THROUGHOUT	NONE DETECTED
31	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BASEMENT	SELECTIVE THROUGHOUT	NONE DETECTED
32	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BASEMENT	SELECTIVE THROUGHOUT	NONE DETECTED
33	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BASEMENT	SELECTIVE THROUGHOUT	NONE DETECTED
34	GRAY VINYL TILE	BASEMENT		NONE DETECTED

**ASSESSMENT OF MATERIALS****Building: HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

Sample #s	Functional Space	Asbestos Type	%	Material And Condition	Comments	Sq. Ft. And/or Linear Footage
27	BASEMENT DUCTWORK, SELECTIVE THROUGHOUT	CHRYSTILE	55%	WHITE DUCT TAPE (GOOD)	SEE RESPONSE ACTIONS	APPROX. 200 LF

**Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

**Inspector: Kyler Spears- Accreditation Number: 192139**

Signature: \_\_\_\_\_

Date: October 8, 2024


**RESPONSE ACTIONS RECOMMENDED**

Building: **HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

MATERIAL	LOCATION	RECOMMENDED RESPONSE ACTIONS
DUCT TAPE (WHITE)	BASEMENT DUCTWORK, SELECTIVE THROUGHOUT	Duct tape is a friable material that is currently in good condition. Must be maintained in an intact condition and kept encapsulated with a high vehicular latex paint. Do not drill through, sand on, or otherwise disturb material. Must be removed prior to renovation or demolition.

**Management Planner:** Don Young - Accreditation Number: 194564

**Signature:**

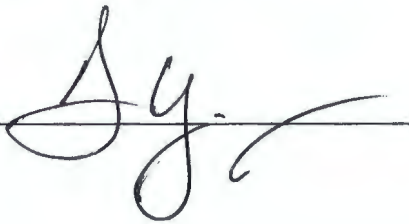

**Date** October 8, 2024



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET,  
VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1169/24-229**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-03-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
1	GRAY/BLACK ASPHALT SHINGLE	TOP LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
2	GRAY/BLACK ASPHALT SHINGLE	SECOND LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
3	GRAY/BLACK ASPHALT SHINGLE	THIRD LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
4	BLACK TAR PAPER	BOTTOM LAYER ROOF	NONE DETECTED	65% CELLULOSE, TAR, ADHESIVE
5	RED BRICK AND GRAY MORTAR	CHIMNEY	NONE DETECTED	CLAY, SAND, CEMENT, AGGREGATE, ADHESIVE
6	WHITE WINDOW GLAZING COMPOUND	EXTERIOR WINDOW	NONE DETECTED	CALCITE, OIL, ADHESIVE
7	BLACK TAR PAPER	UNDER EXTERIOR SIDING	NONE DETECTED	65% CELLULOSE, TAR

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET,  
VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1169/24-229**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-03-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
8	WHITE SHEET VINYL	UNDER PERGO FLOORING FRONT ENTRY	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
9	GRAY PLASTER	FRONT ENTRY	NONE DETECTED	5% HAIR, 5% CELLULOSE, AGGREGATE, CEMENT
10	GRAY PLASTER	LIVING ROOM	NONE DETECTED	5% HAIR, 5% CELLULOSE, AGGREGATE, CEMENT
11	GRAY PLASTER	DINING ROOM	NONE DETECTED	5% HAIR, 5% CELLULOSE, AGGREGATE, CEMENT
12	WHITE WALL TEXTURE	FRONT ENTRY	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
13	WHITE WALL TEXTURE	HALLWAY	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
14	WHITE WALL TEXTURE	KITCHEN	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET,  
VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1169/24-229**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-03-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
15	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
16	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	HALLWAY	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
17	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
18	WHITE CEILING TEXTURE	FRONT ENTRY	NONE DETECTED	CALCIUM CARBONATE, BINDER
19	WHITE CEILING TEXTURE	HALLWAY	NONE DETECTED	CALCIUM CARBONATE, BINDER
20	WHITE CEILING TEXTURE	KITCHEN	NONE DETECTED	CALCIUM CARBONATE, BINDER
21	TAN CERAMIC TILE WITH GROUT	AS COUNTERTOP KITCHEN	NONE DETECTED	CERAMIC, AGGREGATE, CEMENT, ADHESIVE

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT**

**CLIENT:** DATE PARK CONDOMINIUM, INC.  
  
MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628

**SOURCE:** HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET,  
VANCOUVER, WASHINGTON  
**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1169/24-229  
**ANALYZED BY:** KYLER SPEARS

**DATE SAMPLED:** 10-01-24  
**DATE RECEIVED:** 10-01-24  
**DATE COMPLETED:** 10-03-24

**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
22	WHITE SKIM COAT	LIVING ROOM	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
23	WHITE SKIM COAT	KITCHEN	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
24	WHITE SKIM COAT	DINING ROOM	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
25	BLACK VAPOR BARRIER	UNDER PERGO FLOORING KITCHEN	NONE DETECTED	65% CELLULOSE, TAR, ADHESIVE
26	GRAY BACKERBOARD	SECOND LAYER BATHROOM	NONE DETECTED	CALCIUM CARBONATE, AGGREGATE, CEMENT, BINDER
27	WHITE DUCT TAPE	BASEMENT DUCTWORK	55% CHRYSOTILE	10% CELLULOSE, CALCITE, ADHESIVE
28	WHITE WALL TEXTURE	BACK BEDROOM	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** HOUSE AT, 3701 EAST 18<sup>TH</sup> STREET,  
VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1169/24-229**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-03-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
29	WHITE WALL TEXTURE	BACK BEDROOM	NONE DETECTED	CALCIUM CARBONATE, BINDER
30	WHITE WALL TEXTURE	BASEMENT BEDROOM	NONE DETECTED	CALCIUM CARBONATE, BINDER
31	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BASEMENT	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
32	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BASEMENT	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
33	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BASEMENT	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
34	GRAY VINYL TILE	BASEMENT	NONE DETECTED	CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE

**ANALYST:** 

DEVIATION FROM METHOD: NONE

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

## **Certificate of Completion**

This is to certify that

**Kyler J.M. Spears**

has satisfactorily completed  
4 hours of online refresher training as an  
**AHERA Building Inspector**

to comply with the training requirements of  
**TSCA Title II, 40 CFR 763 (AHERA)**

EPA Provider # 1085

192139  
Certificate Number



Instructor: Tracy Bockla

Dec 27, 2023

Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON TRAINING - FORMERLY ARGUS PACIFIC / 21905 64TH AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.285.1171 / ARGUSPACIFIC.COM



## Certificate of Completion

This is to certify that

**Don E. Young**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

194365  
Certificate Number

  
Instructor: Tracy Bockla



• Facilities  
• Environmental  
• Geotechnical  
• Materials

Jul 11, 2024 Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)

TERRACON TRAINING - FORMERLY ARGUS PACIFIC / 21905 64TH AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.285.3373 / ARGUSPACIFIC.COM

## Certificate of Completion

This is to certify that

**Don E. Young**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Management Planner

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

194564  
Certificate Number

  
Instructor: David Welch



• Facilities  
• Environmental  
• Geotechnical  
• Materials

Jul 31, 2024 Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)

TERRACON TRAINING - FORMERLY ARGUS PACIFIC / 21905 64TH AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.285.3373 / ENV-TRAINING-TERRACON.COM

## **Certificate of Completion**

This is to certify that

**Eric S. Viken**

has satisfactorily completed  
4 hours of online refresher training as an  
**AHERA Building Inspector**

to comply with the training requirements of  
**TSCA Title II, 40 CFR 763 (AHERA)**

EPA Provider # 1085

192140  
Certificate Number



Instructor: Tracy Bockla

Dec 27, 2023

Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON TRAINING / FORMERLY ARGUS PACIFIC / 21905 64TH AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98041 / 206.285.3371 / ARGUSPACIFIC.COM

**PHOTOGRAPHIC LOG**

























































*28,29,30  
wall texture*

*31,32,33  
gypsum wallboard  
w/ tape and mud*





# CERTIFIED ENVIRONMENTAL CONSULTING, LLC.

## SURVEY REPORT

DATE: 10-1 SAMPLED BY: KS-EV COST/QUOTE \$ \_\_\_\_\_ LAB # 201169  
 PO#/JOB # 24-229

CLIENT: Nate Park Condominium Inc CONTACT: Asha Prasad

BILLING ADDRESS: \_\_\_\_\_ CITY/STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

House At

PHONE: \_\_\_\_\_ CELL: \_\_\_\_\_ EMAIL/FAX: \_\_\_\_\_

PROJECT ADDRESS: 3701 east 18<sup>th</sup> Vancouver, WA

YEAR BUILT: 1950 TOTAL SF: 2132 CONSTRUCTION TYPE wood, concrete, metal

HOW MANY FLOORS: 2 BASEMENT PRESENT: Yes

ROOFING TYPE: AS BUILDING USE PREVIOUS/CURRENT: Resi / Resi

HEATING SYSTEM: Furnace INSULATION: ATTIC: FG PIPES: Non-Insulated

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
1	AS Grey/Black	TOP layer ROOF	Entire ROOF	
2	AS Grey/Black	2nd layer ROOF	Entire ROOF	
3	AS Grey/Black	3rd layer ROOF	Entire ROOF	
4	TP Black	Bottom Layer ROOF	Entire ROOF	
5	Brick-mortar Red Grey	Chimney		100
6	Wlac white	ext window		15
7	TP Black	under ext side	4/0	
8	Shu white	Front entry under porch		100
9	plaster Grey	Front entry	Sto	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS-1169

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
10	plaster ceiling	Living	Sto	
11	plaster ceiling	Din Room	Sto	
12	wall to white	Front entry	Sto	
13	wall to white	hallway	Sto	
14	wall to white	Kitchen	Sto	
15	ceiling white	Front entry	Sto	
16	ceiling white	hallway	Sto	
17	ceiling white	Kitchen	Sto	
18	ceiling to white	Front entry	Sto	
19	ceiling to white	hallway	Sto	
20	ceiling to white	Kitchen	Sto	
21	ceramic tile 6-10 in	Kitchen AS countertop	Bathroom Floor top layer	140
22	sticker coat white	Living	Kitchen Dining Room	600
23	sticker coat white	Living	Living Room Dining Room	
24	sticker coat white	Bedroom	Living Room Kitchen	



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS-1169

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
25	VB Blank	Kitchen under perg		200
26	Bailler Gaud Cey	2nd Level Bathroom		60
27	Duct tape white	Basement Duct work	STO	200 L
28	wall ft white	Base Bedroom	-1/6	
29	wall ft white	Base Bedroom	1/0	
30	wall ft white	Base ment Bedroom	1/0	
31	LAB TM white	Basement	STO	
32	LAB TM white	Basement	STO	
33	LAB TM white	Basement	STO	
34	vt Cey	Basement		100

# **ASBESTOS SURVEY**

For Building #3 located at:

**3701 ½ EAST 18<sup>TH</sup> STREET  
VANCOUVER, WASHINGTON**

Prepared for:  
Date Park Condominium, Inc.

**CERTIFIED ENVIRONMENTAL CONSULTING, LLC  
615 SE CHKALOV DRIVE SUITE 12  
VANCOUVER, WASHINGTON 98683-5280**

**Prepared by:  
Don Young  
Kyler Spears  
Eric S. Viken**

## EXECUTIVE SUMMARY

Dear Ms. Prasad:

Enclosed are the results of the asbestos survey report conducted by C.E.C., LLC, for Building #3 located at, 3701 ½ East 18<sup>th</sup> Street, in Vancouver, Washington for demolition purposes. This survey was coordinated with you and conducted on October 2, 2024, by Kyler Spears, Don Young, and Eric S. Viken, AHERA certified inspectors.

All samples were taken in a random manner as required by EPA AHERA rules and analyzed using polarized light microscopy with dispersion staining according to EPA and OR-OSHA Methodology. The samples were analyzed in C.E.C., LLC's laboratory at, 615 SE Chkalov Drive Suite #12, in Vancouver, Washington. As the asbestos samples were analyzed in our laboratory, the analytical data enclosed is the analysis report.

**Asbestos was identified in the white sprayed on ceiling texture (See sample data sheet attached). Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

The following survey is divided into the following sections:


- ◇ Summary sheet - details the type and construction of the building with approximate amounts of asbestos in the building.
- ◇ Sample result sheet - contains sample numbers and results, description of materials and homogeneous areas of material.
- ◇ Assessment of materials - contains an assessment of asbestos materials.
- ◇ Response actions recommended - contains the response actions we recommend.
- ◇ Laboratory analysis sheet - contains the results of our laboratory analysis.
- ◇ Inspector's certifications.
- ◇ Photographic log.
- ◇ Asbestos chain of custody form (survey report form).

C.E.C. has investigated accessible and inaccessible areas of this facility in locating suspect ACM using destructive sampling including the interior and exterior. The current extent and condition of the ACM was detected through on-site observation and physical determination.

NOTE: This asbestos survey report is available to Date Park Condominium, Inc., and not to be reproduced in total or part without written consent of Date Park Condominium, Inc.

We appreciate the opportunity to have worked with you. If you have any questions or if we can be of any further service, please contact our office.

Sincerely,



Don Young  
Principal



**SUMMARY SHEET**

**Owner or Representative:** Asha Prasad

**Address:** Building #3 at, 3701 ½ East 18<sup>th</sup> Street

**City:** Vancouver      **State:** Washington

**Owner's Representative:** Date Park Condominium, Inc.  
Ms. Asha Prasad  
6315 SE Evergreen Hwy  
Vancouver, Washington 98661-7628

**Owner/Rep. Telephone Number:** (360) 600-3142

**Surveyed by:** Kyler Spears-Accreditation Number: 192139  
Don Young-Accreditation Number: 194365  
Eric S. Viken-Accreditation Number: 192140

**CONSTRUCTION DATA:**

**Year Built:** Approx.: 1950's      **Size:** Approx. 4,630 SQ FT

**Construction Type:** Wood, Metal, Concrete

**Number of Floors:** 2 with Basement

**Current/Past Use:** Multi-Family/Multi-Family

**Roof Construction:** Asphalt Shingle

**Heating System:** Electric

**Attic Insulation:** Fiberglass

**Pipe Insulation:** Non-Insulated

# **CERTIFIED ENVIRONMENTAL CONSULTING, LLC**

## **SUMMARY DATA**

### **BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

PRODUCT	FUNCTIONAL SPACE	AMOUNT	FRIABLE	CONDITION	SAMPLE #	RESULTS
WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT, UNIT #1: ENTRY, HALLWAY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #1, UNIT #3: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #3, UNIT #2: KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #2	APPROX. 3,600 SQ FT	YES	GOOD	2, 3, 4, 22, 23, 24, 25, 26, 49, 50, 51, 52, 53, 54, 75, 76, 77, 78, 79, 80	<b>7% TO 8% CHRYSTILE</b>

Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.

Certified Environmental Consulting, LLC, warrants that the findings contained herein have been prepared in general accordance with accepted professional practices as applied by similar professionals in the community at the time of this report preparation. Changes in the state of the art or in applicable regulations cannot be anticipated and have not been addressed in this report. The field and laboratory results reported herein are considered sufficient in detail and scope to determine presence of asbestos containing materials in or around the area(s) requested at the time of the inspection. Test results are valid only for the materials tested.

There is a distinct possibility that conditions may exist that could not be identified within the scope of the inspection or that were not apparent during the site visit. This inspection covered only those areas that were exposed or physically accessible to the inspector. The inspection is limited to the information available from the client at the time of the inspection was conducted.

**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
1	BROWN FIBERBOARD	UNDER EXTERIOR SIDING	THROUGHOUT	NONE DETECTED
2	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT		7% CHRYSOTILE
3	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT		7% CHRYSOTILE
4	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT		7% CHRYSOTILE
5	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY MANAGERS UNIT	THROUGHOUT MANAGERS UNIT AND LAUNDRY ROOM	NONE DETECTED
6	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN MANAGERS UNIT	THROUGHOUT MANAGERS UNIT AND LAUNDRY ROOM	NONE DETECTED
7	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM MANAGERS UNIT	THROUGHOUT MANAGERS UNIT AND LAUNDRY ROOM	NONE DETECTED
8	WHITE WALL TEXTURE	LAUNDRY ROOM	KITCHEN MANAGERS UNIT, BATHROOM MANAGERS UNIT	NONE DETECTED
9	WHITE WALL TEXTURE	KITCHEN MANAGERS UNIT	LAUNDRY ROOM, BATHROOM MANAGERS UNIT	NONE DETECTED
10	WHITE WALL TEXTURE	BATHROOM MANAGERS UNIT	LAUNDRY ROOM, KITCHEN MANAGERS UNIT	NONE DETECTED
11	WHITE CEILING TEXTURE	ENTRY MANAGERS UNIT	LAUNDRY ROOM, BATHROOM MANAGERS UNIT	NONE DETECTED
12	WHITE CEILING TEXTURE	LAUNDRY ROOM	ENTRY MANAGERS UNIT, BATHROOM MANAGERS UNIT	NONE DETECTED
13	WHITE CEILING TEXTURE	BATHROOM MANAGERS UNIT	ENTRY MANAGERS UNIT, LAUNDRY ROOM	NONE DETECTED



**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
14	TAN CERAMIC TILE WITH GROUT	KITCHEN MANAGERS UNIT	BATHROOM MANAGERS UNIT	NONE DETECTED
15	BLUE FOAM PAD	UNDER PERGO FLOORING KITCHEN MANAGERS UNIT		NONE DETECTED
16	WHITE SHEET VINYL BACKING	UNDER PERGO FLOORING ENTRY MANAGERS UNIT		NONE DETECTED
17	GRAY VINYL TILE	BATHROOM MANAGERS UNIT		NONE DETECTED
18	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED
19	WHITE/PINK INSULATION	ATTIC BUILDING #3	THROUGHOUT	NONE DETECTED
20	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE
21	WHITE SPRAYED ON CEILING TEXTURE	HALLWAY UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE
22	WHITE SPRAYED ON CEILING TEXTURE	HALLWAY UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE
23	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE
24	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE
25	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE
26	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #1	THROUGHOUT UNIT #1	8% CHRYSOTILE

**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
27	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
28	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
29	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
30	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
31	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
32	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
33	WHITE WALL TEXTURE	ENTRY UNIT #A	THROUGHOUT UNIT #1	NONE DETECTED
34	WHITE WALL TEXTURE	LIVING ROOM UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
35	WHITE WALL TEXTURE	HALLWAY UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
36	WHITE WALL TEXTURE	KITCHEN UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
37	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
38	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #1	THROUGHOUT UNIT #1	NONE DETECTED
39	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED

**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
40	WHITE CEILING TEXTURE	BATHROOM UNIT #1	CLOSET UNIT #1, SECOND FLOOR BATHROOM UNIT #1	NONE DETECTED
41	WHITE CEILING TEXTURE	CLOSET UNIT #1	BATHROOM UNIT #1, SECOND FLOOR BATHROOM UNIT #1	NONE DETECTED
42	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #1	BATHROOM UNIT #1, CLOSET UNIT #1	NONE DETECTED
43	GRAY VINYL TILE	LIVING ROOM UNIT #1	ENTRY UNIT #1	NONE DETECTED
44	GRAY VINYL TILE	TOP LAYER BATHROOM UNIT #1	SECOND FLOOR BATHROOM UNIT #1	NONE DETECTED
45	WHITE LEVELING COMPOUND	BOTTOM LAYER BATHROOM UNIT #1	SECOND LAYER KITCHEN UNIT #1	NONE DETECTED
46	BROWN VAPOR BARRIER	BOTTOM LAYER KITCHEN UNIT #1	THROUGHOUT	NONE DETECTED
47	WHITE CERAMIC TILE WITH GROUT	AS BACKSPLASH KITCHEN UNIT #1		NONE DETECTED
48	GRAY CERAMIC TILE WITH GROUT	SECOND FLOOR BATHROOM		NONE DETECTED
49	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #3	THROUGHOUT UNIT #3	<b>8% CHRYSOTILE</b>
50	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #3	THROUGHOUT UNIT #3	<b>8% CHRYSOTILE</b>
51	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #3	THROUGHOUT UNIT #3	<b>8% CHRYSOTILE</b>
52	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #3	THROUGHOUT UNIT #3	<b>8% CHRYSOTILE</b>



**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
53	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #3	THROUGHOUT UNIT #3	<b>8% CHRYSOTILE</b>
54	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #3	THROUGHOUT UNIT #3	<b>8% CHRYSOTILE</b>
55	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
56	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
57	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
58	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
59	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
60	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
61	WHITE WALL TEXTURE	ENTRY UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
62	WHITE WALL TEXTURE	LIVING ROOM UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
63	WHITE WALL TEXTURE	KITCHEN UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
64	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
65	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED
66	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #3	THROUGHOUT UNIT #3	NONE DETECTED

**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
67	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED
68	TAN CERAMIC TILE WITH GROUT	TOP LAYER KITCHEN UNIT #3		NONE DETECTED
69	GRAY BACKERBOARD	BOTTOM LAYER KITCHEN UNIT #3		NONE DETECTED
70	WHITE CEILING TEXTURE	BATHROOM UNIT #3	CLOSET UNIT #3, SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED
71	WHITE CEILING TEXTURE	CLOSET UNIT #3	BATHROOM UNIT #3, SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED
72	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #3	BATHROOM UNIT #3, CLOSET UNIT #3	NONE DETECTED
73	GRAY VINYL TILE	BATHROOM UNIT #3		NONE DETECTED
74	TAN SHEET VINYL	SECOND FLOOR BATHROOM UNIT #3		NONE DETECTED
75	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #2	THROUGHOUT UNIT #2	<b>8% CHRYSOTILE</b>
76	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #2	THROUGHOUT UNIT #2	<b>8% CHRYSOTILE</b>
77	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #2	THROUGHOUT UNIT #2	<b>8% CHRYSOTILE</b>
78	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #2	THROUGHOUT UNIT #2	<b>8% CHRYSOTILE</b>
79	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #2	THROUGHOUT UNIT #2	<b>8% CHRYSOTILE</b>
80	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #2	THROUGHOUT UNIT #2	<b>8% CHRYSOTILE</b>

**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

SAMPLE #	SAMPLE DESCRIPTION	SAMPLE LOCATION	HOMOGENEOUS AREA	ASBESTOS CONTENT
81	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
82	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
83	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
84	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
85	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
86	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
87	WHITE WALL TEXTURE	ENTRY UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
88	WHITE WALL TEXTURE	LIVING ROOM UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
89	WHITE WALL TEXTURE	KITCHEN UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
90	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
91	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
92	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #2	THROUGHOUT UNIT #2	NONE DETECTED
93	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED



**SAMPLE RESULTS****BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
94	GRAY VINYL TILE	TOP LAYER KITCHEN UNIT #2	BATHROOM UNIT #2	NONE DETECTED
95	TAN VINYL TILE	BOTTOM LAYER KITCHEN UNIT #2		NONE DETECTED
96	WHITE CEILING TEXTURE	BATHROOM UNIT #2	LAUNDRY ROOM UNIT #2, CLOSET UNIT #2, SECOND FLOOR BATHROOM UNIT #2	NONE DETECTED
97	WHITE CEILING TEXTURE	CLOSET UNIT #2	LAUNDRY ROOM UNIT #2, BATHROOM UNIT #2, SECOND FLOOR BATHROOM UNIT #2	NONE DETECTED
98	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #2	LAUNDRY ROOM UNIT #2, BATHROOM UNIT #2, CLOSET UNIT #2	NONE DETECTED
99	WHITE SHOWER SURROUND	SECOND FLOOR BATHROOM UNIT #2		NONE DETECTED
100	BROWN ASPHALT SHINGLE	TOP LAYER ROOF	ENTIRE ROOF	NONE DETECTED
101	BROWN ASPHALT SHINGLE	SECOND LAYER ROOF	ENTIRE ROOF	NONE DETECTED
102	BLACK TAR PAPER	BOTTOM LAYER ROOF	ENTIRE ROOF	NONE DETECTED

**ASSESSMENT OF MATERIALS**

**Building: BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

Sample #s	Functional Space	Asbestos Type	%	Material And Condition	Comments	Sq. Ft. And/or Linear Footage
2, 3, 4, 22, 23, 24, 25, 26, 49, 50, 51, 52, 53, 54, 75, 76, 77, 78, 79, 80	KITCHEN MANAGERS UNIT, UNIT #1- HALLWAY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #1, UNIT #3-ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #3, UNIT #2-KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #2	CHRYSTOLE	7% TO 8%	WHITE SPRAYED ON CEILING TEXTURE (GOOD)	SEE RESPONSE ACTIONS	APPROX. 3,600 SQ FT

**Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

**Inspector: Kyler Spears- Accreditation Number: 192139**

Signature:  Date: October 17, 2024


**RESPONSE ACTIONS RECOMMENDED**

Building: **BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER,  
WASHINGTON**

MATERIAL	LOCATION	RECOMMENDED RESPONSE ACTIONS
SPRAYED ON CEILING TEXTURE (WHITE)	KITCHEN MANAGERS UNIT, UNIT #1-HALLWAY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #1, UNIT #3-ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #3, UNIT #2-KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #2	Sprayed on ceiling texture is a friable material, which is currently in good condition and poses no health risk in its current state. It is important to keep it encapsulated with a high vehicular latex paint. Do not sand on, drill through, remove, or otherwise disturb material. Must be removed prior to renovation or demolition.

**Management Planner:** Don Young - Accreditation Number: 194564

**Signature:** \_\_\_\_\_



**Date** October 17, 2024



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
1	BROWN FIBERBOARD	UNDER EXTERIOR SIDING	NONE DETECTED	65% CELLULOSE, WOOD, ADHESIVE
2	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
3	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
4	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN MANAGERS UNIT	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
5	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY MANAGERS UNIT	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
6	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN MANAGERS UNIT	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1189/24-237  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
7	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM MANAGERS UNIT	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
8	WHITE WALL TEXTURE	LAUNDRY ROOM	NONE DETECTED	CALCIUM CARBONATE, BINDER
9	WHITE WALL TEXTURE	KITCHEN MANAGERS UNIT	NONE DETECTED	CALCIUM CARBONATE, BINDER
10	WHITE WALL TEXTURE	BATHROOM MANAGERS UNIT	NONE DETECTED	CALCIUM CARBONATE, BINDER
11	WHITE CEILING TEXTURE	ENTRY MANAGERS UNIT	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
12	WHITE CEILING TEXTURE	LAUNDRY ROOM	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
13	WHITE CEILING TEXTURE	BATHROOM MANAGERS UNIT	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
14	TAN CERAMIC TILE WITH GROUT	KITCHEN MANAGERS UNIT	NONE DETECTED	CLAY, SAND, CERAMIC, CEMENT, AGGREGATE
15	BLUE FOAM PAD	UNDER PERGO FLOORING KITCHEN MANAGERS OFFICE	NONE DETECTED	SYNTHETIC FOAM, ADHESIVE
16	WHITE SHEET VINYL BACKING	UNDER PERGO FLOORING ENTRY MANAGERS UNIT	NONE DETECTED	40% CELLULOSE, CALCITE, ADHESIVE
17	GRAY VINYL TILE	BATHROOM MANAGERS UNIT	NONE DETECTED	CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
18	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, DEBRIS, TAR

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
19	WHITE/PINK INSULATION	ATTIC BUILDING #3	NONE DETECTED	80% FIBERGLASS, DEBRIS
20	BROWN FLOOR MASTIC	LAUNDRY ROOM	NONE DETECTED	CLAY, ADHESIVE
21	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #1	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
22	WHITE SPRAYED ON CEILING TEXTURE	HALLWAY UNIT #1	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
23	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #1	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
24	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #1	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
25	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #1	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
26	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #1	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
27	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #1	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
28	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #1	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
29	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #1	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
30	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #1	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
31	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #1	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
32	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #1	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
33	WHITE WALL TEXTURE	ENTRY UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
34	WHITE WALL TEXTURE	LIVING ROOM UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
35	WHITE WALL TEXTURE	HALLWAY UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
36	WHITE WALL TEXTURE	KITCHEN UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



# CERTIFIED ENVIRONMENTAL CONSULTING, LLC

## SAMPLE ANALYSIS REPORT

CLIENT: DATEPARK CONDOMINIUM, INC.

SOURCE: BUILDING #3 AT, 3701 1/2 EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON

MS. ASHA PRASAD

SAMPLED BY: KYLER SPEARS/ERIC S. VIKEN

6315 SE EVERGREEN HWY

LAB/JOB #: JJ-1189/24-237

VANCOUVER, WASHINGTON 98661-7628

ANALYZED BY: KYLER SPEARS

DATE SAMPLED: 10-02-24

DATE RECEIVED: 10-02-24

DATE COMPLETED: 10-10-24

ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
37	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
38	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
39	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, DEBRIS, TAR
40	WHITE CEILING TEXTURE	BATHROOM UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
41	WHITE CEILING TEXTURE	CLOSET UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
42	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

ANALYST:



DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

REVIEWED BY:



**SAMPLE ANALYSIS REPORT**

**CLIENT:** DATE PARK CONDOMINIUM, INC.

MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628

**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON

**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1189/24-237  
**ANALYZED BY:** KYLER SPEARS

**DATE SAMPLED:** 10-02-24

**DATE RECEIVED:** 10-02-24

**DATE COMPLETED:** 10-10-24

**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
43	GRAY VINYL TILE	LIVING ROOM UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, ADHESIVE
44	GRAY VINYL TILE	TOP LAYER BATHROOM UNIT #1	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, ADHESIVE
45	WHITE LEVELING COMPOUND	BOTTOM LAYER BATHROOM UNIT #1	NONE DETECTED	CALCIUM CARBONATE, BINDER, ADHESIVE
46	BROWN VAPOR BARRIER	BOTTOM LAYER KITCHEN UNIT #1	NONE DETECTED	65% CELLULOSE, TAR, ADHESIVE
47	WHITE CERAMIC TILE WITH GROUT	AS BACKSPLASH KITCHEN UNIT #1	NONE DETECTED	CLAY, SAND, CEMENT, ADHESIVE, AGGREGATE
48	GRAY CERAMIC TILE WITH GROUT	SECOND FLOOR BATHROOM UNIT #1	NONE DETECTED	CLAY, SAND, CERAMIC, AGGREGATE, ADHESIVE

**ANALYST:**

DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1189/24-237  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
49	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #3	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
50	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #3	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
51	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #3	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
52	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #3	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
53	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #3	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
54	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #3	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
55	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #3	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
56	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM UNIT #3	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
57	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #3	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
58	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #3	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
59	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
60	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1189/24-237  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
61	WHITE WALL TEXTURE	ENTRY UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
62	WHITE WALL TEXTURE	LIVING ROOM UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
63	WHITE WALL TEXTURE	KITCHEN UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
64	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
65	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
66	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
67	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, DEBRIS, TAR
68	TAN CERAMIC TILE WITH GROUT	TOP LAYER KITCHEN UNIT #3	NONE DETECTED	CLAY, SAND, CEMENT, CERAMIC, ADHESIVE
69	GRAY BACKERBOARD	BOTTOM LAYER KITCHEN UNIT #3	NONE DETECTED	55% CELLULOSE, CEMENT, ADHESIVE
70	WHITE CEILING TEXTURE	BATHROOM UNIT #3	NONE DETECTED	CALCIUM CARBONATE, BINDER
71	WHITE CEILING TEXTURE	CLOSET UNIT #3	NONE DETECTED	CALCIUM CARBONATE, BINDER
72	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
73	GRAY VINYL TILE	BATHROOM UNIT #3	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
74	TAN SHEET VINYL	SECOND FLOOR BATHROOM UNIT #3	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
75	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #2	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
76	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #2	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
77	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #2	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
78	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #2	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
79	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #2	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
80	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #2	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
81	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #2	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
82	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #2	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
83	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #2	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
84	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #2	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
85	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #2	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
86	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #2	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
87	WHITE WALL TEXTURE	ENTRY UNIT #2	NONE DETECTED	CALCIUM CARBONATE, BINDER
88	WHITE WALL TEXTURE	LIVING ROOM UNIT #2	NONE DETECTED	CALCIUM CARBONATE, BINDER
89	WHITE WALL TEXTURE	KITCHEN UNIT #2	NONE DETECTED	CALCIUM CARBONATE, BINDER
90	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #2	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
91	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #2	NONE DETECTED	CALCIUM CARBONATE, BINDER
92	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #2	NONE DETECTED	CALCIUM CARBONATE, BINDER
93	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, DEBRIS, TAR
94	GRAY VINYL TILE	TOP LAYER KITCHEN UNIT #2	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
95	TAN VINYL TILE	BOTTOM LAYER KITCHEN UNIT #2	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
96	WHITE CEILING TEXTURE	BATHROOM UNIT #2	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #3 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1189/24-237**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-02-24**DATE RECEIVED:** 10-02-24**DATE COMPLETED:** 10-10-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
97	WHITE CEILING TEXTURE	CLOSET UNIT #2	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
98	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #2	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
99	WHITE SHOWER SURROUND	SECOND FLOOR BATHROOM UNIT #2	NONE DETECTED	55% FIBERGLASS, VINYL, ADHESIVE
100	BROWN ASPHALT SHINGLE	TOP LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
101	BROWN ASPHALT SHINGLE	SECOND LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
102	BLACK TAR PAPER	BOTTOM LAYER ROOF	NONE DETECTED	65% CELLULOSE, TAR

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

## Certificate of Completion

This is to certify that


**Kyler J.M. Spears**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

192139  
Certificate Number



Instructor: Tracy Bockla



- Facilities
- Environmental
- Geotechnical
- Materials

Dec 27, 2023

Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)

TERRACON TRAINING & DEVELOPMENT, LLC 122905 4TH AVE W, SUITE 1000, MOUNTAIN TERRACE, WASHINGTON 98040 | (360) 254-9385 | ARGOSPACIFIC.COM

## Certificate of Completion

This is to certify that  
**Don E. Young**  
has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector  
to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)  
EPA Provider # 1085

194365  
Certificate Number

  
Instructor: Tracy Bockla



- Facilities
- Environmental
- Geotechnical
- Materials

Jul 11, 2024 Expires in 1 year.  
Date(s) of Training  
Exam Score: N/A  
(if applicable)

## Certificate of Completion

This is to certify that  
**Don E. Young**  
has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Management Planner  
to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)  
EPA Provider # 1085

194564  
Certificate Number

  
Instructor: David Welch



- Facilities
- Environmental
- Geotechnical
- Materials

Jul 31, 2024 Expires in 1 year.  
Date(s) of Training  
Exam Score: N/A  
(if applicable)

## Certificate of Completion

This is to certify that

**Eric S. Viken**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of

TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

192140  
Certificate Number



Instructor: Tracy Bockla



- Facilities
- Environmental
- Geotechnical
- Materials

Dec 27, 2023 Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)

THIS IS A TRAINING COURSE FOR AHERA BUILDING INSPECTORS. COURSE WITH AHERA, 10011 MOUNTAIN TERRACE, WASHINGTON 98040. (206) 261-1321 • AHERASPACE.COM




**PHOTOGRAPHIC LOG**











***11,12,13***  
***ceiling texture***

























*27,28,29*

*30,31,32*

*gypsum wallboard  
w/ tape & mud*

*33,34,35*

*36,37,38*

*wall texture*

*39*

*wall insulation*





















































**CERTIFIED ENVIRONMENTAL CONSULTING, LLC.**  
**SURVEY REPORT**

24-237

DATE: 10-2 SAMPLED BY: US-EP COST/QUOTE \$ \_\_\_\_\_ LAB # JJ-189  
PO#/JOB # \_\_\_\_\_

CLIENT: Dele Park Condominium LLC CONTACT: Asha Prasad

BILLING ADDRESS: \_\_\_\_\_ CITY/STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

PHONE: \_\_\_\_\_ CELL: Building #3 EMAIL/FAX: \_\_\_\_\_

PROJECT ADDRESS: 3701 1/2 east 18<sup>th</sup> street, Vancouver, WA

YEAR BUILT: 1950 TOTAL SF: 4630 CONSTRUCTION TYPE wood, concrete, mtl

HOW MANY FLOORS: 2 BASEMENT PRESENT: NO

ROOFING TYPE: AS BUILDING USE PREVIOUS/CURRENT: Res / Res

HEATING SYSTEM: Electric INSULATION: ATTIC: FC PIPES: Non-Insulated

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
1	Fiberboard Brown	under east side	tlc	
2	spout white	Kitchen managers unit		200
3	spout white	Kitchen managers unit		
4	spout white	Kitchen managers unit		
5	ceiling white	entry managers unit	tlc managers unit & laundry room	
6	ceiling white	Kitchen managers unit	tlc managers unit & laundry room	
7	ceiling white	Bathroom managers unit	tlc managers unit & laundry room	
8	wall tile white	1/2 laundry room	kitchen Bathroom	500
9	wall tile white	kitchen	laundry room Bathroom	

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280 (503) 221-7904 (360) 254-9385

1-20  
Managers unit  
Laundry

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS-1189

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
10	wall <sup>txt</sup> white	Bathroom managers unit	Laundry Room Kitchen - managers unit	
11	ceiling <sup>txt</sup> white	entry managers unit	Laundry Room Bathroom <sup>mgrs unit</sup>	<del>100</del> 240
12	ceiling <sup>txt</sup> white	Laundry Room	Entry mgr's unit Bathroom mgr's unit	
13	ceiling <sup>txt</sup> white	Bathroom managers unit	Entry mgr's unit Laundry Room	
14	ceramic floor to go	Kitchen managers unit	Bathroom managers unit	100
15	foam panel Blue	Kitchen managers unit under peryo panel		200
16	Shv Backing white	entry under managers pers o Flaming unit		100
17	VT Grey	Bathroom managers unit		40
18	Insulation Black	ext wall	46	
19	Insulation white/pink	attic <sup>blg</sup> #3	410	
20	Flow master Brown	Laundry Room		100
21	spock white	entry unit #1	T/O unit #1	1280
22	spock white	hallway unit #1	T/O unit #1	
23	spock white	Kitchen unit #1	T/O unit #1	
24	spock white	nd floor unit #1 hallway	T/O unit #1	

5  
it  
#1

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # SS-118<sup>09</sup>

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION unit #	HOMOGENEOUS AREA	SQ FOOTAGE
25	spout white	2nd Floor Bedroom on left	T/O unit #1	
26	spout white	2nd Floor unit #2 Bedroom on right	T/O unit #1	
27	cup on white	entry wall unit #1	T/O unit #1	
28	cup on white	LOU unit #1	T/O unit #1	
29	cup on white	Kitchen wall unit #1	T/O unit #1	
30	cup on white	2nd Floor unit #1 hall ceiling	T/O unit #1	
31	cup on white	2nd Floor unit #1 Bathroom ceiling	T/O unit #1	
32	cup on white	2nd Floor unit #1 Bedroom ceiling	T/O unit #1	
33	wall test white	entry unit #1	T/O unit #1	
34	wall test white	LOU unit #1	T/O unit #1	
35	wall test white	hallway unit #1	T/O unit #1	
36	wall test white	Kitchen unit #1	T/O unit #1	
37	wall test white	2nd Floor hallway unit #1	T/O unit #1	
38	wall test white	2nd Floor Bedroom on right	T/O unit #1	
39	Insulation Black	test wall	tlc	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS-1189

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
40	ceiling tile white	Bathroom unit #1	Close unit #1 2nd fl Bathroom unit #1	100
41	ceiling tile white	Close unit #1	Bathroom unit #1 2nd floor Bathroom unit #1	
42	ceiling tile white	2nd floor Bathroom unit #1	Bathroom unit #1 Close unit #1	
43	VT Gray	LVR unit #1	entry unit #1	400
44	VT Gray 900	Top layer Bathroom unit #1	2nd floor Bathroom unit #1	80
45	Leaky cond white	Bottom layer Bathroom unit #1	Kitchen 2nd layer unit #1	500
46	VB Brown	Kitchen unit #1 Bottom layer	fl	
47	ceramic tile lv white	Kitchen AS Ball spg unit #1		100
48	ceramic tile G Gray	2nd floor Bathroom		100
49	spout white	entry unit #3	T/O unit #3	1200
50	spout white	LVR unit #3	T/O unit #3	
51	spout white	Kitchen unit #3	T/O unit #3	
52	spout white	2nd floor Hallway unit #3	T/O unit #3	
53	spout white	2nd floor Bedroom on left unit #3	T/O unit #3	
54	spout white	2nd floor Bedroom on right unit #3	T/O unit #3	



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB# 55-1189

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
55	CerB <sup>TM</sup> white	entry wall unit #3	1/0 unit #3	
56	CerB <sup>TM</sup> white	LVR wall unit #3	1/0 unit #3	
57	CerB <sup>TM</sup> white	Kitchen wall unit #3	1/0 unit #3	
58	CerB <sup>TM</sup> white	2nd floor hall wall unit #3	1/0 unit #3	
59	CerB <sup>TM</sup> white	2nd floor Bathroom unit #3	1/0 unit #3	
60	CerB <sup>TM</sup> white	2nd floor Bedroom	1/0 unit #3	
61	wall ft white	entry unit #3	1/0 unit #3	
62	wall ft white	LVR unit #3	1/0 unit #3	
63	wall ft white	Kitchen unit #3	1/0 unit #3	
64	wall ft white	2nd floor hall wall unit #3	1/0 unit #3	
65	wall ft white	2nd floor Bathroom unit #3	1/0 unit #3	
66	wall ft white	2nd floor Bedroom on left unit #3	1/0 unit #3	
67	Forstleion Black	ext wall	1/0	
68	Ceramic tile Top	Kitchen TOP layer unit #3		150
69	Backer Board Bottom	Kitchen Bottom layer unit #3		1

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JJ-1189

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
70	ceiling txt white	Bathroom unit #3	closet unit #3 2nd fl Bathroom unit #3	100
71	ceiling txt white	closet unit #3	Bathroom unit #3 2nd fl Bathroom unit #3	
72	ceiling txt white	2nd floor Bathroom unit #3	Bathroom unit #3 closet unit #3	
73	VT Gray	Bathroom unit #3		40
74	Shu Tan	2nd floor Bathroom unit #3		40
75	spacet white	Kitchen unit #2	T/O unit #2	1000
76	spacet white	Kitchen unit #2	T/O unit #2	
77	spacet white	2nd floor hallway unit #2	T/O unit #2	
78	spacet white	2nd floor Bedroom or loft unit #2	T/O unit #2	
79	spacet white	2nd floor Bedroom unit #2	T/O unit #2	
80	spacet white	Kitchen unit #2	T/O unit #2	
81	AWB T4 white	entry wall unit #2	T/O unit #2	
82	AWB T4 white	Living room wall unit #2	T/O unit #2	
83	AWB T4 white	Kitchen wall unit #2	T/O unit #2	
84	AWB T4 white	2nd floor hallway unit #2 - ceiling	T/O unit #2	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS-1189

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
85	curb in white	2nd Floor Bathroom unit #2	T/O unit #2	
86	curb in white	2nd Floor Bedroom on unit #2	T/O unit #2	
87	wall test white	entry unit #2	T/O unit #2	
88	wall test white	LOD unit #2	T/O unit #2	
89	wall test white	Kitchen unit #2	T/O unit #2	
90	wall test white	2nd Floor Hallway unit #2	T/O unit #2	
91	wall test white	2nd Floor unit #2 Bathroom on left	T/O unit #2	
92	wall test white	2nd Floor Bathroom on right unit #2	T/O unit #2	
93	Exterior Black	ext wall	+10	
94	VT Gray	Kitchen TOP unit #2	Bathroom unit #2	100
95	<del>Flap</del> tan	Bottom Kitchen unit #2		
96	ceiling test white	Bathroom unit #2	Laundry Room unit #2 Closet unit #2 2nd Fl Bathroom	140
97	ceiling test white	Closet unit #2	Laundry Room unit #2 Bathroom unit #2 2nd Fl Bathroom unit #2	
98	ceiling test white	2nd Floor Bathroom unit #2	Laundry Room unit #2 Closet unit #2 Bathroom unit #2	
99	Shower surround white	2nd Floor Bathroom unit #2		1

**❖CERTIFIED ENVIRONMENTAL CONSULTING, LLC.❖**

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

**(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633**

## SURVEY SAMPLE FORM

**LAB #**

55-1189

[illegible]



# **ASBESTOS SURVEY**

For Building #4 located at:

**3701 ½ EAST 18<sup>TH</sup> STREET  
VANCOUVER, WASHINGTON**

Prepared for:  
Date Park Condominium, Inc.

**CERTIFIED ENVIRONMENTAL CONSULTING, LLC  
615 SE CHKALOV DRIVE SUITE 12  
VANCOUVER, WASHINGTON 98683-5280**

Prepared by:  
**Don Young  
Kyler Spears  
Eric S. Viken**

**EXECUTIVE SUMMARY**

Dear Ms. Prasad:

Enclosed are the results of the asbestos survey report conducted by C.E.C., LLC, for Building #4 located at, 3701 ½ East 18<sup>th</sup> Street, in Vancouver, Washington for demolition purposes. This survey was coordinated with you and conducted on October 1, 2024, by Kyler Spears, Don Young, and Eric S. Viken, AHERA certified inspectors.

All samples were taken in a random manner as required by EPA AHERA rules and analyzed using polarized light microscopy with dispersion staining according to EPA and OR-OSHA Methodology. The samples were analyzed in C.E.C., LLC's laboratory at, 615 SE Chkalov Drive Suite #12, in Vancouver, Washington. As the asbestos samples were analyzed in our laboratory, the analytical data enclosed is the analysis report.

**Asbestos was identified in the white sprayed on ceiling texture, and brown sheet vinyl (See sample data sheet attached). Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

The following survey is divided into the following sections:


- ◇ Summary sheet - details the type and construction of the building with approximate amounts of asbestos in the building.
- ◇ Sample result sheet - contains sample numbers and results, description of materials and homogeneous areas of material.
- ◇ Assessment of materials - contains an assessment of asbestos materials.
- ◇ Response actions recommended - contains the response actions we recommend.
- ◇ Laboratory analysis sheet - contains the results of our laboratory analysis.
- ◇ Inspector's certifications.
- ◇ Photographic log.
- ◇ Asbestos chain of custody form (survey report form).

C.E.C. has investigated accessible and inaccessible areas of this facility in locating suspect ACM using destructive sampling including the interior and exterior. The current extent and condition of the ACM was detected through on-site observation and physical determination.

NOTE: This asbestos survey report is available to Date Park Condominium, Inc., and not to be reproduced in total or part without written consent of Date Park Condominium, Inc.

We appreciate the opportunity to have worked with you. If you have any questions or if we can be of any further service, please contact our office.

Sincerely,

  
Don Young  
Principal

**SUMMARY SHEET**

**Owner or Representative:** Asha Prasad

**Address:** Building #4 at, 3701 ½ East 18<sup>th</sup> Street

**City:** Vancouver      **State:** Washington

**Owner's Representative:**    Date Park Condominium, Inc.  
   Ms. Asha Prasad  
   6315 SE Evergreen Hwy  
   Vancouver, Washington 98661-7628

**Owner/Rep. Telephone Number:** (360) 600-3142

**Surveyed by:** Kyler Spears-Accreditation Number: 192139  
                         Don Young-Accreditation Number: 194365  
                         Eric S. Viken-Accreditation Number: 192140

**CONSTRUCTION DATA:**

**Year Built:** Approx.: 1950's                      **Size:** Approx. 4,000 SQ FT

**Construction Type:** Wood, Metal, Concrete

**Number of Floors:** 2

**Current/Past Use:** Multi-Family/Multi-Family

**Roof Construction:** Asphalt Shingle

**Heating System:** Electric/Baseboard

**Attic Insulation:** Fiberglass

**Pipe Insulation:** Non-Insulated

**SUMMARY DATA****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

PRODUCT	FUNCTIONAL SPACE	AMOUNT	FRIABLE	CONDITION	SAMPLE #	RESULTS
WHITE SPRAYED ON CEILING TEXTURE	UNIT #4-ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #4 UNIT #6-KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #6 UNIT #8-ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #8, UNIT #7-ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #7	APPROX. 4,600 SQ FT	YES	GOOD	1, 2, 3, 4, 5, 6, 51, 52, 53, 54, 55, 78, 79, 80, 81, 82, 83, 103, 104, 105, 106, 107, 108	7% TO 8% CHRYSTILE
BROWN SHEET VINYL	BOTTOM LAYER KITCHEN UNIT #7	APPROX. 100 SQ FT	YES	GOOD	123	20% CHRYSTILE

Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.

Certified Environmental Consulting, LLC, warrants that the findings contained herein have been prepared in general accordance with accepted professional practices as applied by similar professionals in the community at the time of this report preparation. Changes in the state of the art or in applicable regulations cannot be anticipated and have not been addressed in this report. The field and laboratory results reported herein are considered sufficient in detail and scope to determine presence of asbestos containing materials in or around the area(s) requested at the time of the inspection. Test results are valid only for the materials tested.

There is a distinct possibility that conditions may exist that could not be identified within the scope of the inspection or that were not apparent during the site visit. This inspection covered only those areas that were exposed or physically accessible to the inspector. The inspection is limited to the information available from the client at the time of the inspection was conducted.



**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
1	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #4	THROUGHOUT UNIT #4	7% CHRYSOTILE
2	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #4	THROUGHOUT UNIT #4	7% CHRYSOTILE
3	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #4	THROUGHOUT UNIT #4	7% CHRYSOTILE
4	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #4	THROUGHOUT UNIT #4	7% CHRYSOTILE
5	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #4	THROUGHOUT UNIT #4	7% CHRYSOTILE
6	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT	THROUGHOUT UNIT #4	7% CHRYSOTILE
7	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
8	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
9	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
10	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
11	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
12	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
13	WHITE WALL TEXTURE	ENTRY UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
14	WHITE WALL TEXTURE	LIVING ROOM UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
15	WHITE WALL TEXTURE	KITCHEN UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED

**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
16	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
17	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
18	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #4	THROUGHOUT UNIT #4	NONE DETECTED
19	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED
20	OFF WHITE/TAN CERAMIC TILE WITH GROUT	KITCHEN UNIT #4		NONE DETECTED
21	WHITE CEILING TEXTURE	BATHROOM UNIT #4	CLOSET UNIT #4, SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED
22	WHITE CEILING TEXTURE	CLOSET UNIT #4	BATHROOM UNIT #4, SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED
23	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #4	BATHROOM UNIT #4, CLOSET UNIT #4	NONE DETECTED
24	TAN SHEET VINYL	TOP LAYER UNDER PERGO FLOORING KITCHEN UNIT #4		NONE DETECTED
25	WHITE SHEET VINYL	BOTTOM LAYER UNDER PERGO FLOORING KITCHEN UNIT #4		NONE DETECTED
26	WHITE/GREEN SHEET VINYL	BATHROOM UNIT #4		NONE DETECTED
27	BROWN VAPOR BARRIER	BOTTOM LAYER UNDER PERGO FLOORING AND PRESSBOARD ENTRY UNIT #4		NONE DETECTED
28	TAN CERAMIC TILE WITH GROUT	TOP LAYER SECOND FLOOR BATHROOM UNIT #4		NONE DETECTED
29	GRAY BACKERBOARD	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #4		NONE DETECTED
30	BROWN FIBERBOARD	UNDER EXTERIOR SIDING	THROUGHOUT	NONE DETECTED

**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
31	WHITE CEILING TEXTURE	ENTRY UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
32	WHITE CEILING TEXTURE	LIVING ROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
33	WHITE CEILING TEXTURE	KITCHEN UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
34	WHITE CEILING TEXTURE	BATHROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
35	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
36	WHITE CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
37	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
38	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
39	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	HALLWAY WALL UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
40	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
41	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
42	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
43	WHITE WALL TEXTURE	ENTRY UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
44	WHITE WALL TEXTURE	LIVING ROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
45	WHITE WALL TEXTURE	KITCHEN UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED

**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
46	WHITE WALL TEXTURE	BATHROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
47	WHITE WALL TEXTURE	CLOSET UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
48	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #5	THROUGHOUT UNIT #5	NONE DETECTED
49	GRAY VINYL TILE	FRONT ENTRY	THROUGHOUT UNIT #5	NONE DETECTED
50	PINK INSULATION	EXTERIOR WALL	THROUGHOUT EXTERIOR WALLS AND ATTIC	NONE DETECTED
51	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #6	THROUGHOUT UNIT #6	7% CHRYSOTILE
52	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #6	THROUGHOUT UNIT #6	7% CHRYSOTILE
53	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #6	THROUGHOUT UNIT #6	7% CHRYSOTILE
54	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #6	THROUGHOUT UNIT #6	7% CHRYSOTILE
55	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #6	THROUGHOUT UNIT #6	7% CHRYSOTILE
56	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #6	THROUGHOUT UNIT #6	7% CHRYSOTILE
57	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
58	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
59	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM WALL UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
60	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED



**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
61	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
62	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
63	WHITE WALL TEXTURE	ENTRY UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
64	WHITE WALL TEXTURE	LIVING ROOM UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
65	WHITE WALL TEXTURE	BATHROOM UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
66	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
67	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT#6	THROUGHOUT UNIT #6	NONE DETECTED
68	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #6	THROUGHOUT UNIT #6	NONE DETECTED
69	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED
70	LIGHT BROWN VINYL TILE	KITCHEN UNIT #6	BATHROOM UNIT #6	NONE DETECTED
71	BROWN VINYL TILE	ENTRY UNIT #6		NONE DETECTED
72	WHITE CEILING TEXTURE	BATHROOM UNIT #6	LIVING ROOM UNIT #6, SECOND FLOOR BATHROOM UNIT #6	NONE DETECTED
73	WHITE CEILING TEXTURE	LIVING ROOM UNIT #6	BATHROOM UNIT #6, SECOND FLOOR BATHROOM UNIT #6	NONE DETECTED
74	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #6	BATHROOM UNIT #6, LIVING ROOM UNIT #6	NONE DETECTED
75	BACKSPLASH MASTIC	KITCHEN UNIT #6		NONE DETECTED

**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
76	WHITE CERAMIC TILE WITH GROUT	SECOND FLOOR BATHROOM UNIT #6		NONE DETECTED
77	WHITE INSULATION	ATTIC	THROUGHOUT	NONE DETECTED
78	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #8	THROUGHOUT UNIT #8	8% CHRYSOTILE
79	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #8	THROUGHOUT UNIT #8	8% CHRYSOTILE
80	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #8	THROUGHOUT UNIT #8	8% CHRYSOTILE
81	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #8	THROUGHOUT UNIT #8	8% CHRYSOTILE
82	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #8	THROUGHOUT UNIT #8	8% CHRYSOTILE
83	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #8	THROUGHOUT UNIT #8	8% CHRYSOTILE
84	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
85	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
86	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
87	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
88	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
89	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
90	WHITE WALL TEXTURE	ENTRY UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED

**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
91	WHITE WALL TEXTURE	LIVING ROOM UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
92	WHITE WALL TEXTURE	KITCHEN UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
93	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
94	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
95	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #8	THROUGHOUT UNIT #8	NONE DETECTED
96	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED
97	BROWN SHEET VINYL	UNDER PERGO FLOORING KITCHEN UNIT #8		NONE DETECTED
98	TAN CERAMIC TILE WITH GROUT	KITCHEN UNIT #8	TOP LAYER BATHROOM UNIT #8	NONE DETECTED
99	GRAY BACKERBOARD	BOTTOM LAYER BATHROOM UNIT #8		NONE DETECTED
100	WHITE CEILING TEXTURE	BATHROOM UNIT #8	SECOND FLOOR BATHROOM UNIT #8, CLOSET UNIT #8	NONE DETECTED
101	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #8	BATHROOM UNIT #8, CLOSET UNIT #8	NONE DETECTED
102	WHITE CEILING TEXTURE	CLOSET UNIT #8	BATHROOM UNIT #8, SECOND FLOOR BATHROOM UNIT #8	NONE DETECTED
103	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #7	THROUGHOUT UNIT #7	8% CHRYSOTILE
104	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #7	THROUGHOUT UNIT #7	8% CHRYSOTILE
105	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #7	THROUGHOUT UNIT #7	8% CHRYSOTILE

**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
106	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #7	THROUGHOUT UNIT #7	8% CHRYSOTILE
107	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #7	THROUGHOUT UNIT #7	8% CHRYSOTILE
108	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #7	THROUGHOUT UNIT #7	8% CHRYSOTILE
109	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
110	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
112	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
113	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
114	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON RIGHT UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
115	WHITE WALL TEXTURE	ENTRY UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
116	WHITE WALL TEXTURE	KITCHEN UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
117	WHITE WALL TEXTURE	LIVING ROOM UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
118	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
119	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
120	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #7	THROUGHOUT UNIT #7	NONE DETECTED
121	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED



**SAMPLE RESULTS****BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

SAMPLE #	SAMPLE DESCRIPTION	SAMPLE LOCATION	HOMOGENEOUS AREA	ASBESTOS CONTENT
122	LIGHT BROWN VINYL TILE	TOP LAYER KITCHEN UNIT #7		NONE DETECTED
123	BROWN SHEET VINYL	BOTTOM LAYER KITCHEN UNIT #7		20% CHRYSOTILE
124	WHITE COUNTERTOP MATERIAL	KITCHEN UNIT #7	SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED
125	WHITE CEILING TEXTURE	BATHROOM UNIT #7	CLOSET UNIT #7, SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED
126	WHITE CEILING TEXTURE	CLOSET UNIT #7	BATHROOM UNIT #7, SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED
127	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #7	BATHROOM UNIT #7, CLOSET UNIT #7	NONE DETECTED
128	GRAY SHEET VINYL	BATHROOM UNIT #7		NONE DETECTED
129A	WHITE/GREEN COVE BASE	BATHROOM UNIT #7	SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED
129B	BROWN COVE BASE MASTIC	BATHROOM UNIT #7	SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED
130	BLUE/WHITE SHEET VINYL	TOP LAYER SECOND FLOOR BATHROOM UNIT #7		NONE DETECTED
131	WHITE SHEET VINYL	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #7		NONE DETECTED
132	WHITE SHOWER SURROUND	SECOND FLOOR BATHROOM UNIT #7		NONE DETECTED
133	BLACK ASPHALT SHINGLE	TOP LAYER ROOF	ENTIRE ROOF	NONE DETECTED
134	BLACK ASPHALT SHINGLE	SECOND LAYER ROOF	ENTIRE ROOF	NONE DETECTED
135	BLACK TAR PAPER	BOTTOM LAYER ROOF	ENTIRE ROOF	NONE DETECTED

**ASSESSMENT OF MATERIALS**

**Building: BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

Sample #s	Functional Space	Asbestos Type	%	Material And Condition	Comments	Sq. Ft. And/or Linear Footage
1, 2, 3, 4, 5, 6, 51, 52, 53, 54, 55, 78, 79, 80, 81, 82, 83, 103, 104, 105, 106, 107, 108	UNIT #4: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #4 UNIT #6: KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #6 UNIT #8: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #8 UNIT #7: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #7	CHRYSTILE	7% TO 8%	WHITE SPRAYED ON CEILING TEXTURE (GOOD)	SEE RESPONSE ACTIONS	APPROX. 4,600 SQ FT
123	BOTTOM LAYER KITCHEN UNIT #7	CHRYSTILE	20%	BROWN SHEET VINYL (GOOD)	SEE RESPONSE ACTIONS	APPROX. 100 SQ FT

**Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

**Inspector: Kyler Spears- Accreditation Number: 192139**

**Signature:**



**Date: October 21, 2024**

**RESPONSE ACTIONS RECOMMENDED**

Building: **BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER,  
WASHINGTON**

MATERIAL	LOCATION	RECOMMENDED RESPONSE ACTIONS
SPRAYED ON CEILING TEXTURE (WHITE)	UNIT #4: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #4 UNIT #6: KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #6 UNIT #8: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #8 UNIT #7: ENTRY, LIVING ROOM, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #7	Sprayed on ceiling texture is a friable material, which is currently in good condition and poses no health risk in its current state. It is important to keep it encapsulated with a high vehicular latex paint. Do not sand on, drill through, remove, or otherwise disturb material. Must be removed prior to renovation or demolition.
SHEET VINYL (BROWN)	BOTTOM LAYER KITCHEN UNIT #7	Sheet vinyl is a friable material currently in good condition and poses no health hazards in its present state. Do not drill through, sand on, tear, remove, or otherwise disturb material. Must be removed prior to renovation or demolition.

Management Planner: Don Young - Accreditation Number: 194564

Signature: \_\_\_\_\_



Date October 17, 2024

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
1	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #4	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
2	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #4	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
3	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #4	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
4	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #4	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
5	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #4	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
6	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #4	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
7	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #4	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
8	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #4	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
9	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #4	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
10	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
11	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #4	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
12	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #4	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
13	WHITE WALL TEXTURE	ENTRY UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
14	WHITE WALL TEXTURE	LIVING ROOM UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
15	WHITE WALL TEXTURE	KITCHEN UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
16	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
17	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
18	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
19	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	70% FIBERGLASS, DEBRIS, TAR
20	OFF WHITE/TAN CERAMIC TILE WITH GROUT	KITCHEN UNIT #4	NONE DETECTED	CLAY, SAND, CERAMIC, AGGREGATE, ADHESIVE
21	WHITE CEILING TEXTURE	BATHROOM UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
22	WHITE CEILING TEXTURE	CLOSET UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
23	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED	CALCIUM CARBONATE, BINDER
24	TAN SHEET VINYL	TOP LAYER UNDER PERGO FLOORING KITCHEN UNIT #4	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
25	WHITE SHEET VINYL	BOTTOM LAYER UNDER PERGO FLOORING KITCHEN UNIT #4	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, VINYL, CALCITE, ADHESIVE
26	WHITE/GREEN SHEET VINYL	BATHROOM UNIT #4	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
27	BROWN VAPOR BARRIER	BOTTOM LAYER UNDER PERGO FLOORING AND PRESSBOARD ENTRY UNIT #4	NONE DETECTED	65% CELLULOSE, TAR, ADHESIVE
28	TAN CERAMIC TILE WITH GROUT	TOP LAYER SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED	CLAY, SAND, CEMENT, CERAMIC, AGGREGATE
29	GRAY BACKERBOARD	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #4	NONE DETECTED	65% CELLULOSE, CEMENT, AGGREGATE
30	BROWN FIBERBOARD	UNDER EXTERIOR SIDING	NONE DETECTED	65% CELLULOSE, TAR, WOOD, ADHESIVE

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
31	WHITE CEILING TEXTURE	ENTRY UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
32	WHITE CEILING TEXTURE	LIVING ROOM UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
33	WHITE CEILING TEXTURE	KITCHEN UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
34	WHITE CEILING TEXTURE	BATHROOM UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
35	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
36	WHITE CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
37	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #5	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
38	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #5	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
39	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	HALLWAY WALL UNIT #5	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
40	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #5	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
41	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #5	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
42	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #5	NONE DETECTED	12% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
43	WHITE WALL TEXTURE	ENTRY UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
44	WHITE WALL TEXTURE	LIVING ROOM UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
45	WHITE WALL TEXTURE	KITCHEN UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
46	WHITE WALL TEXTURE	BATHROOM UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
47	WHITE WALL TEXTURE	CLOSET UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER
48	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #5	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.**MS. ASHA PRASAD**  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1188/24-236  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

<b>SAMPLE ID #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>ASBESTOS CONTENT</b>	<b>OTHER MATERIAL</b>
49	GRAY VINYL TILE	FRONT ENTRY	NONE DETECTED	CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
50	PINK INSULATION	EXTERIOR WALL	NONE DETECTED	80% FIBERGLASS, DEBRIS
51	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #6	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
52	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #6	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
53	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #6	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
54	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #6	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
55	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #6	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, BINDER
56	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #6	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, BINDER
57	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #6	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
58	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #6	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
59	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM WALL UNIT #6	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
60	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #6	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
61	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #6	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
62	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM UNIT #6	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
63	WHITE WALL TEXTURE	ENTRY UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
64	WHITE WALL TEXTURE	LIVING ROOM UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
65	WHITE WALL TEXTURE	BATHROOM UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
66	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
67	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
68	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
69	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	70% FIBERGLASS, DEBRIS, TAR
70	LIGHT BROWN VINYL TILE	KITCHEN UNIT #6	NONE DETECTED	CALCIUM CARBONATE, VINYL, BINDER
71	BROWN VINYL TILE	ENTRY UNIT #6	NONE DETECTED	CALCIUM CARBONATE, VINYL, BINDER
72	WHITE CEILING TEXTURE	BATHROOM UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
73	WHITE CEILING TEXTURE	LIVING ROOM UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
74	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #6	NONE DETECTED	CALCIUM CARBONATE, BINDER
75	BACK SPLASH MASTIC	KITCHEN UNIT #6	NONE DETECTED	ADHESIVE, CLAY, BINDER
76	WHITE CERAMIC TILE WITH GROUT	SECOND FLOOR BATHROOM UNIT #6	NONE DETECTED	CLAY, SAND, CERAMIC, AGGREGATE, ADHESIVE
77	WHITE INSULATION	ATTIC	NONE DETECTED	90% FIBERGLASS, DEBRIS
78	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #8	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
79	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #8	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
80	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #8	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
81	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #8	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
82	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #8	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
83	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #8	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
84	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #8	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
85	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #8	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
86	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #8	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
87	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #8	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
88	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM UNIT #8	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
89	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #8	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
90	WHITE WALL TEXTURE	ENTRY UNIT #8	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1188/24-236  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
91	WHITE WALL TEXTURE	LIVING ROOM UNIT #8	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
92	WHITE WALL TEXTURE	KITCHEN UNIT #8	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
93	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #8	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
94	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #8	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
95	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #8	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
96	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	70% FIBERGLASS, DEBRIS

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
97	BROWN SHEET VINYL	UNDER PERGO FLOORING KITCHEN UNIT #8	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
98	TAN CERAMIC TILE WITH GROUT	KITCHEN UNIT #8	NONE DETECTED	SAND, CLAY, CERAMIC, AGGREGATE, ADHESIVE
99	GRAY BACKERBOARD	BOTTOM LAYER BATHROOM UNIT #8	NONE DETECTED	CLAY, AGGREGATE, CEMENT, ADHESIVE
100	WHITE CEILING TEXTURE	BATHROOM UNIT #8	NONE DETECTED	CALCIUM CARBONATE, BINDER
101	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #8	NONE DETECTED	CALCIUM CARBONATE, BINDER
102	WHITE CEILING TEXTURE	CLOSET UNIT #8	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
103	WHITE SPRAYED ON CEILING TEXTURE	ENTRY UNIT #7	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
104	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #7	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
105	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT#7	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
106	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #7	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
107	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #7	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
108	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #7	8% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section I,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
109	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	ENTRY WALL UNIT #7	NONE DETECTED	15% FIBERGLASS, 5% CELLULOSE, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
110	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #7	NONE DETECTED	15% FIBERGLASS, 5% CELLULOSE, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
111	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #7	NONE DETECTED	15% FIBERGLASS, 5% CELLULOSE, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
112	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #7	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
113	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #7	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
114	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON RIGHT UNIT #7	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1188/24-236  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
115	WHITE WALL TEXTURE	ENTRY UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
116	WHITE WALL TEXTURE	KITCHEN UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
117	WHITE WALL TEXTURE	LIVING ROOM UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
118	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
119	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
120	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
121	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, TAR, ADHESIVE, DEBRIS
122	LIGHT BROWN VINYL TILE	TOP LAYER KITCHEN UNIT #7	NONE DETECTED	CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
123	BROWN SHEET VINYL	BOTTOM LAYER KITCHEN UNIT #7	20% CHRYSTOTILE	10% CELLULOSE, VINYL, CALCITE, ADHESIVE
124	WHITE COUNTERTOP MATERIAL	KITCHEN UNIT #7	NONE DETECTED	55% CELLULOSE, FORMICA, EPOXY, ADHESIVE
125	WHITE CEILING TEXTURE	BATHROOM UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
126	WHITE CEILING TEXTURE	CLOSET UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
127	WHITE CEILING TEXTURE	SECOND FLOOR BEDROOM UNIT #7	NONE DETECTED	CALCIUM CARBONATE, BINDER
128	GRAY SHEET VINYL	BATHROOM UNIT #7	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
129A	WHITE/GREEN COVE BASE	BATHROOM UNIT #7	NONE DETECTED	SILICONE, CALCIUM CARBONATE, BINDER
129B	BROWN COVE BASE MASTIC	BATHROOM UNIT #7	NONE DETECTED	ADHESIVE
130	BLUE/WHITE SHEET VINYL	TOP LAYER SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
131	WHITE SHEET VINYL	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
132	WHITE SHOWER SURROUND	SECOND FLOOR BATHROOM UNIT #7	NONE DETECTED	55% FIBERGLASS, VINYL, ADHESIVE
133	BLACK ASPHALT SHINGLE	TOP LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
134	BLACK ASPHALT SHINGLE	SECOND LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
135	BLACK TAR PAPER	BOTTOM LAYER ROOF	NONE DETECTED	65% CELLULOSE, TAR, DEBRIS

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

## Certificate of Completion

This is to certify that

**Kyler J.M. Spears**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of

TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

192139  
Certificate Number



Instructor: Tracy Bockla

Dec 27, 2023 Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(If applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON TRAINING LLC - FORMERLY ARGUS PACIFIC / 21905 64TH AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.285.3373 / ARGUSPACIFIC.COM

## Certificate of Completion

This is to certify that  
**Don E. Young**  
has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector  
to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)  
EPA Provider # 1085

194365  
Certificate Number

  
Instructor: Tracy Bockla

Jul 11, 2024 Expires in 1 year.  
Date(s) of Training  
Exam Score: N/A  
(if applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280

## Certificate of Completion

This is to certify that  
**Don E. Young**  
has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Management Planner  
to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)  
EPA Provider # 1085

194564  
Certificate Number

  
Instructor: David Welch

Jul 31, 2024 Expires in 1 year.  
Date(s) of Training  
Exam Score: N/A  
(if applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280

11000 N. 40TH AVE. VANCOUVER, WA 98683-5280



## Certificate of Completion

This is to certify that


**Eric S. Viken**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

192140  
Certificate Number



Instructor: Tracy Bockla

Dec 27, 2023 Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(If applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON TRAINING - FORMERLY ARGUS PACIFIC / 21905 64TH AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.285.1171 / ARGUSPACIFIC.COM

**PHOTOGRAPHIC LOG**


























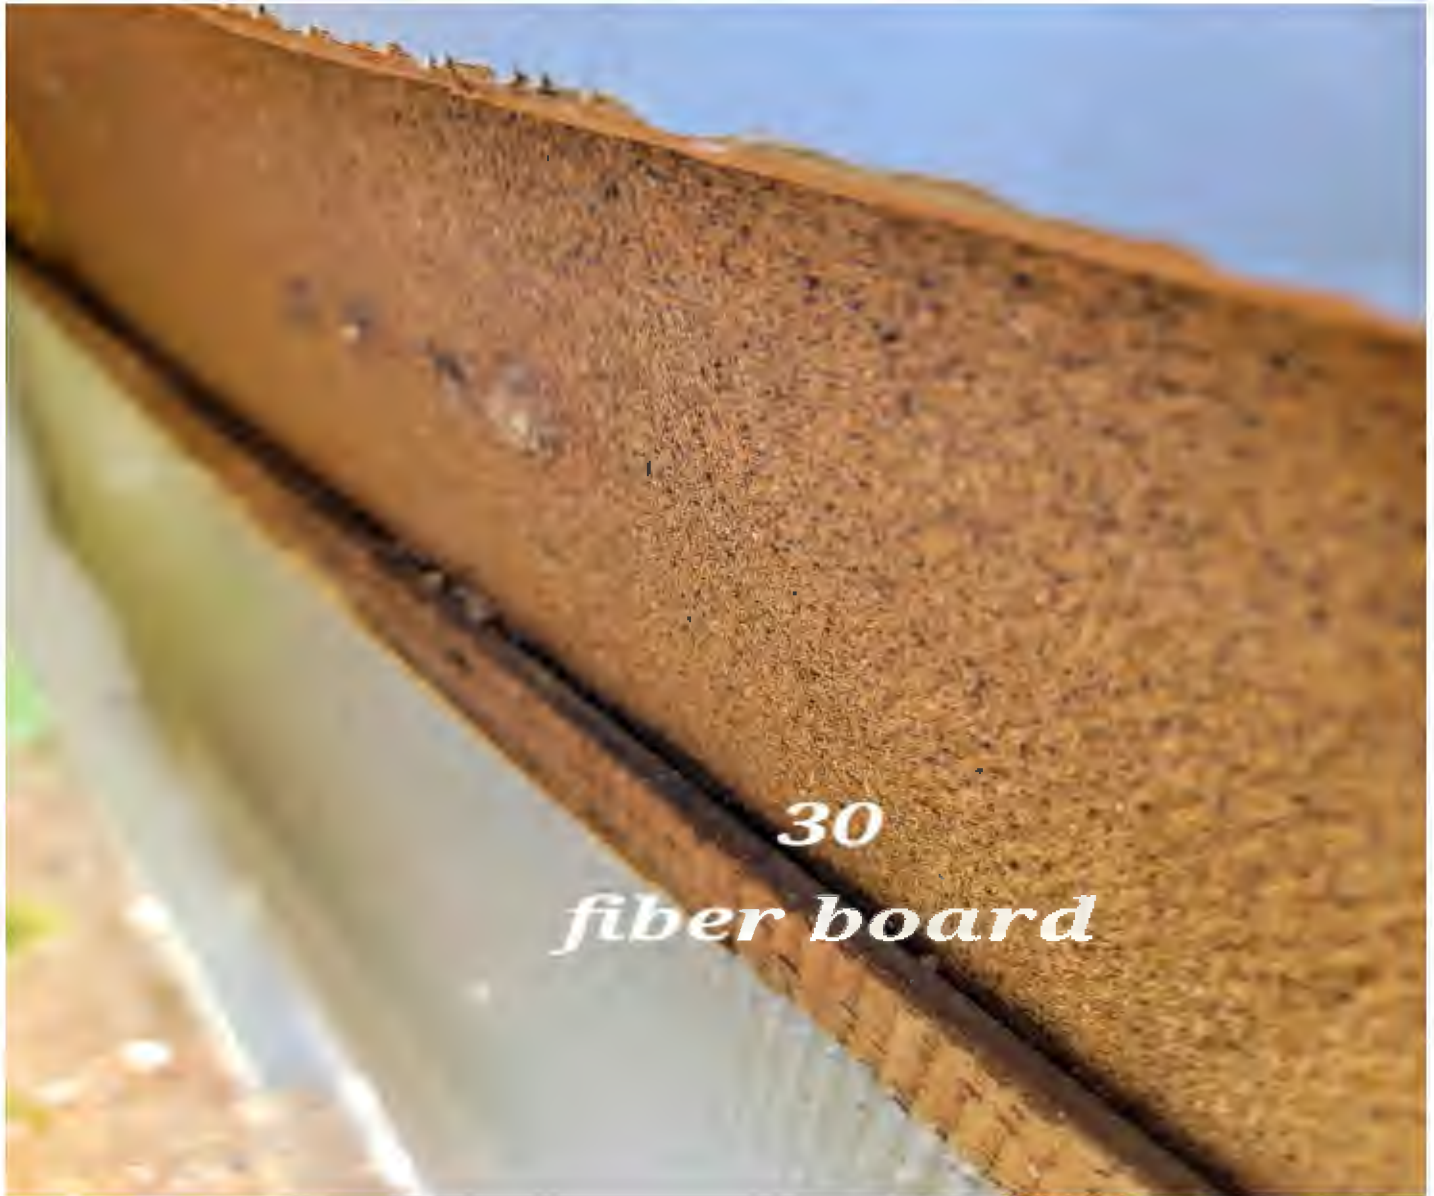




*31,32,33  
34,35,36  
ceiling texture*



*37,38,39*

*40,41,42*

*gypsum wallboard  
w/ tape & mud*

*43,44,45*

*46,47,48*

*wall texture*







*51,52,53*  
*54,55,56*  
*popcorn ceiling texture*
























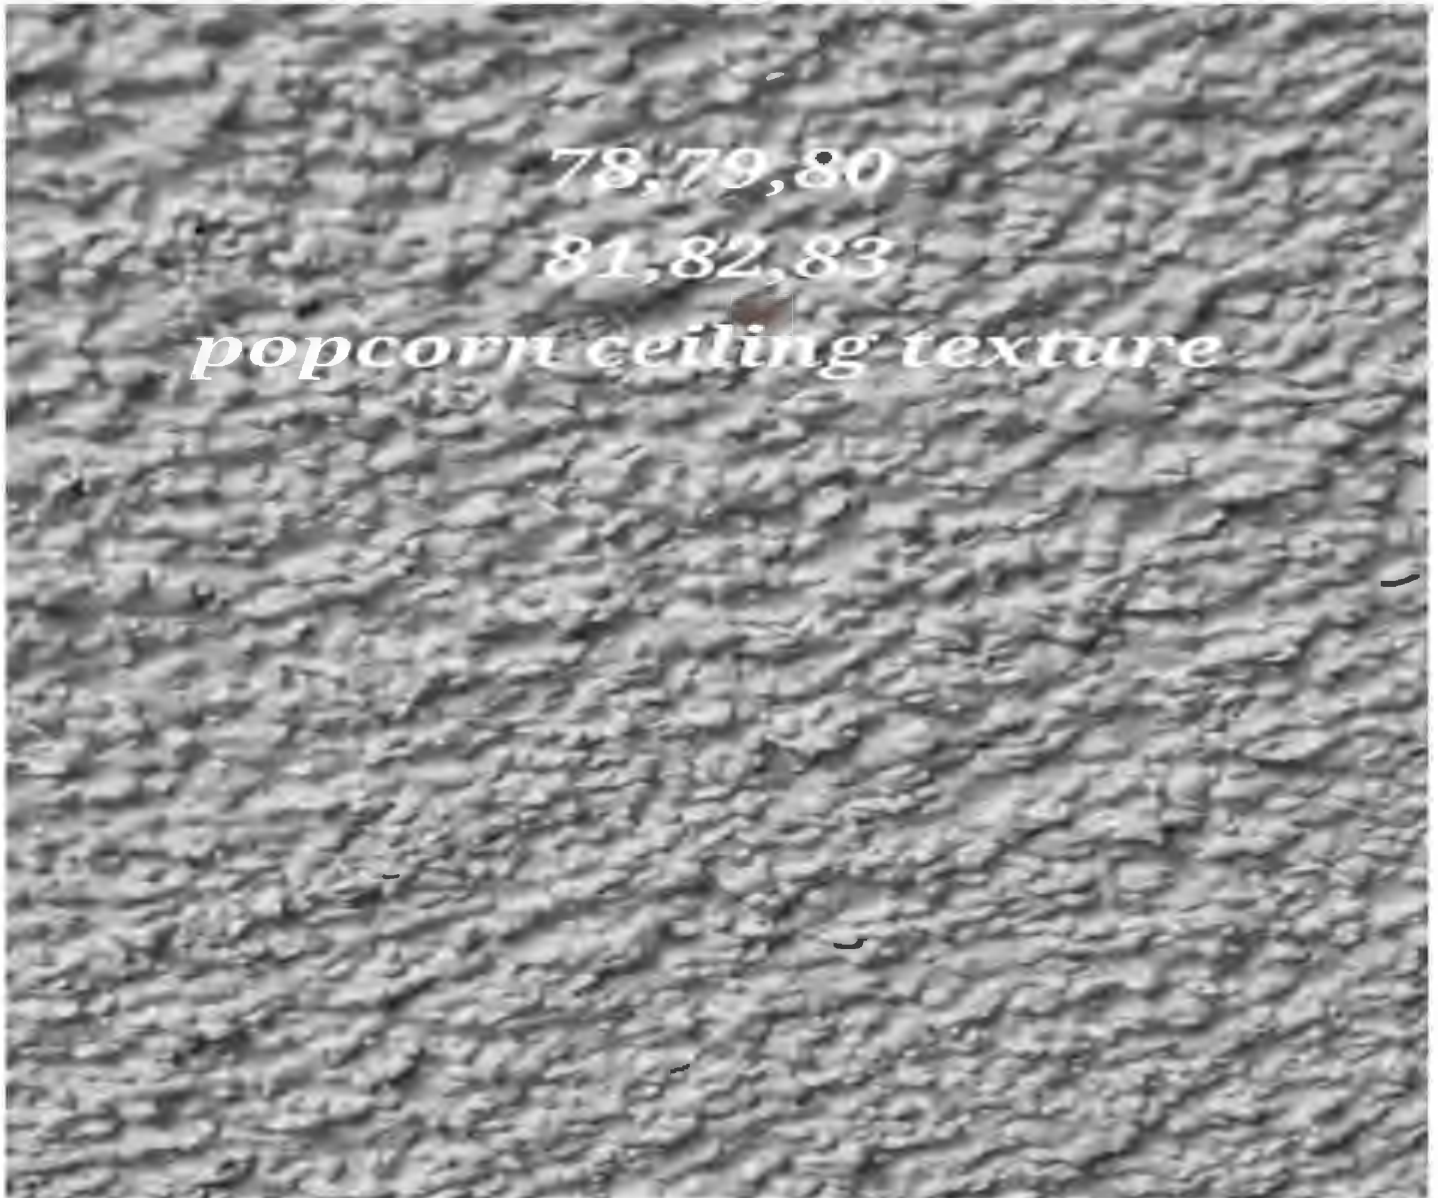



*84,85,86*

*87,88,89*

*gypsum wallboard  
w/ tape & mud*

*90,91,92*

*93,94,95*

*wall texture*

*96*

*wall insulation*
















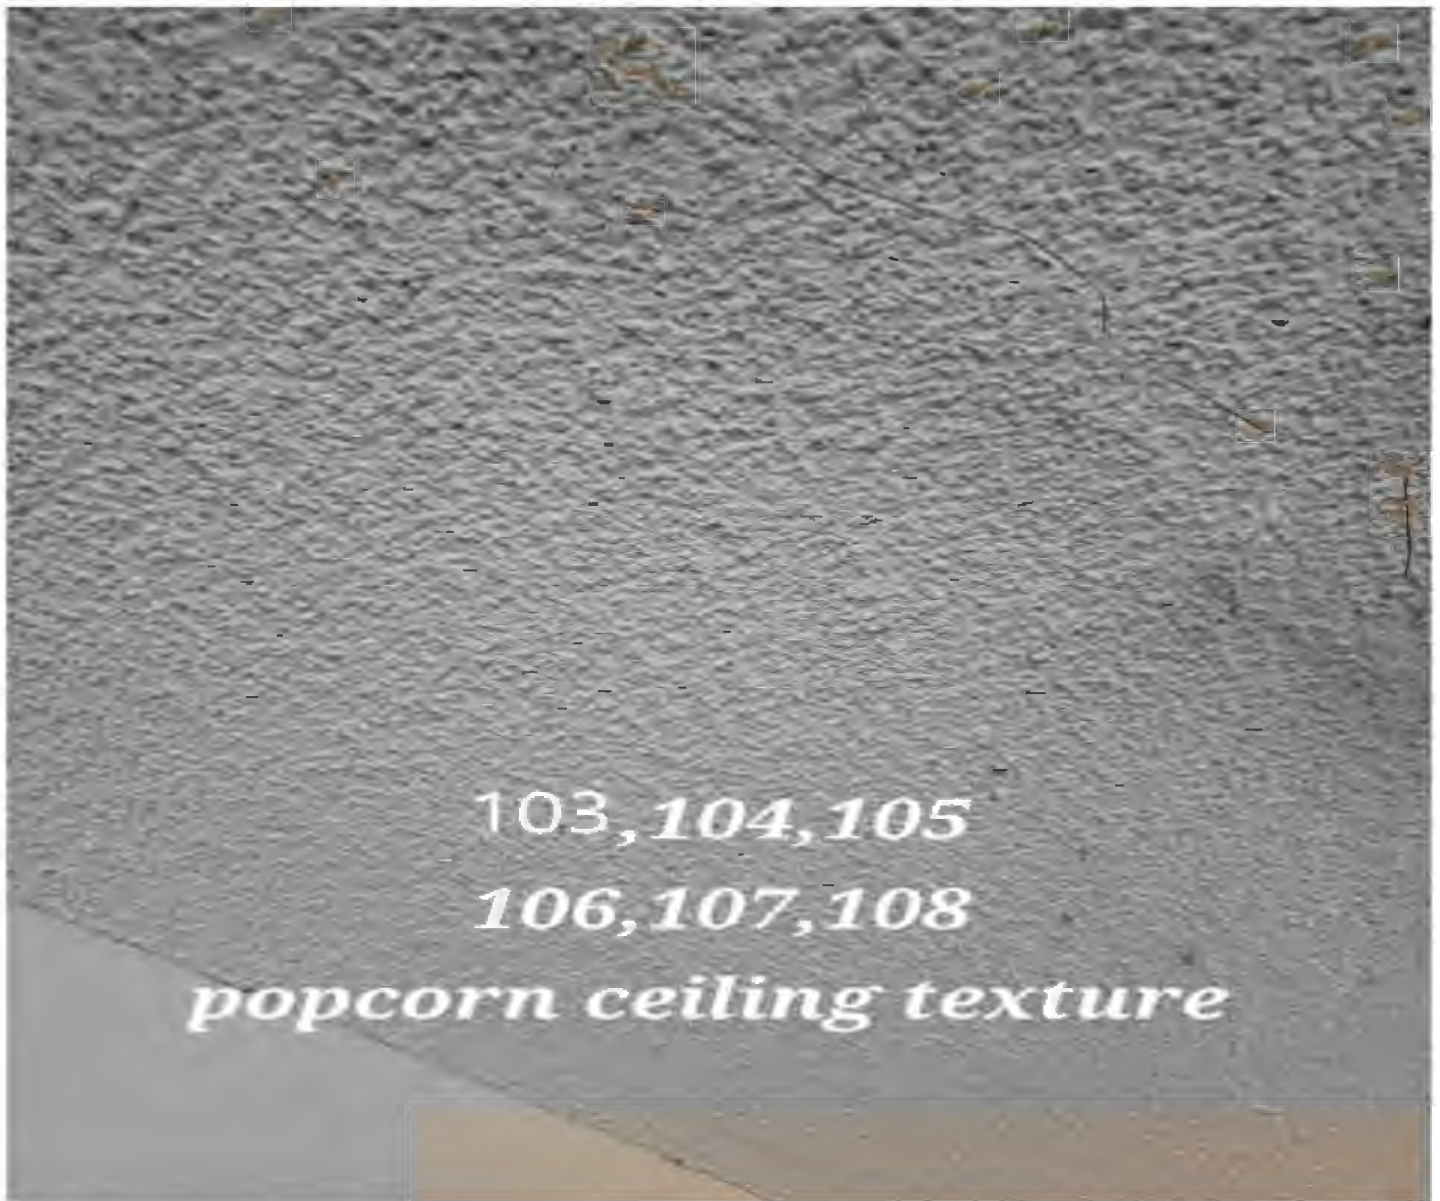



*109,110,111  
112,113,114  
gypsum wallboard  
w/ tape & mud  
115,116,117  
118,119,120  
wall texture  
121  
wall insulation*

























# CERTIFIED ENVIRONMENTAL CONSULTING, LLC.

## SURVEY REPORT

DATE: 10-1 SAMPLED BY: VS LEV COST/QUOTE \$ \_\_\_\_\_ LAB # 24-236  
 PO#/JOB # 55-1188

CLIENT: Duke Park Condominium LLC CONTACT: Asha Prasad

BILLING ADDRESS: \_\_\_\_\_ CITY/STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

PHONE: \_\_\_\_\_ CELL: Building #4 EMAIL/FAX: \_\_\_\_\_

PROJECT ADDRESS: 3701 1/2 east 18<sup>th</sup> street, Vancouver, WA  
 YEAR BUILT: 1950 IS TOTAL SF: 4000 CONSTRUCTION TYPE wood, cement, metal

HOW MANY FLOORS: 2 BASEMENT PRESENT: No

ROOFING TYPE: AS BUILDING USE PREVIOUS/CURRENT: Residential

HEATING SYSTEM: Electric / Baseboard INSULATION: ATTIC: FG PIPES: non-insulated

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
1	Spout white	entry unit #4	T/O unit #4	1200
2	Spout white	Loe unit #4	T/O unit #4	
3	Spout white	Kitchen unit #4	T/O unit #4	
4	Spout white	2nd floor hallway unit #4	T/O unit #4	
5	Spout white	2nd floor Bedroom unit #4	T/O unit #4	
6	Spout white	2nd floor Bedroom unit #4	T/O unit #4	
7	Curb in white	entry wall unit #4	T/O unit #4	
8	Curb in white	Loe wall unit #4	T/O unit #4	
9	Curb in white	Kitchen wall unit #4	T/O unit #4	

1-30  
unit #4

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # 55-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
10	Wib <sup>m</sup> white	2nd Fl Bathroom unit #4	To unit #4	
11	Wib <sup>m</sup> white	2nd Fl Hallway unit #4	To unit #4	
12	Wib <sup>m</sup> white	2nd Fl Bedroom on left unit #4	To unit #4	
13	Wan f <sup>t</sup> white	entr unit #4	To unit #4	
14	Wall f <sup>t</sup> white	LP unit #4	To unit #4	
15	Wall f <sup>t</sup> white	Kitchen unit #4	To unit #4	
16	Wall f <sup>t</sup> white	2nd Fl hallway unit #4	To unit #4	
17	Wall f <sup>t</sup> white	2nd Fl Bedroom on left unit #4	To unit #4	
18	Wall f <sup>t</sup> white	2nd Fl Bathroom unit #4	To unit #4	
19	Black insulation	ext wall	To	
20	offwhite/tan Ceramic tile w/ Grout	Kitchen unit #4		100
21	ceiling f <sup>t</sup> white	Bathroom unit #4	Closet unit #4 2nd Floor Bathroom unit #4	100
22	ceiling f <sup>t</sup> white	Closet unit #4	Bathroom unit #4 2nd Fl Bathroom unit #4	
23	ceiling f <sup>t</sup> white	2nd Fl Bathroom unit #4	Bathroom unit #4 Closet unit #4	
24	Shv Tan	Top Layer under Pergo Floor in Kitchen unit #4		200



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB #

55-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
25	Shw white Bottom	Bottom layer under Pergo flooring kitchen unit #4		200
26	Shw-white (Green)	Bathroom unit #4		40
27	VB Brown Bottom	Bottom layer under Pergo Pressboard entry unit #4	Flr unit #4	
28	ceramic tile G-Tan	Top layer 2nd fl Bathroom unit #4		
29	Backer board Gray	Bottom layer 2nd fl Bathroom unit #4		
30	Fiber board Brown	wall ext side	T/O	
31	ceil's tile white	entry unit #5	T/O unit #5	
32	ceil's tile white	2nd fl unit #5	T/O unit #5	
33	ceil's tile white	Kitchen unit #5	T/O unit #5	
34	ceil's tile white	Bathroom unit #5	T/O unit #5	
35	ceil's tile white	2nd fl Bathroom unit #5	T/O unit #5	
36	ceil's tile white	2nd fl Hallway unit #5	T/O unit #5	
37	Wall 8th white	Entry wall unit #5	T/O unit #5	
38	Wall 8th white	Living room wall unit #5	T/O unit #5	
39	Wall 8th white	Hallway wall unit #5	T/O unit #5	

125

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB #

JJ-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
40	WUBTH white	2nd fl hallway ceiling unit #5	T/O unit #5	
41	WUBTH white	2nd fl Bedroom on west ceiling unit #5	T/O unit #5	
42	WUBTH white	2nd fl Bathroom unit #5	T/O unit #5	
43	Wall 1st white	entry unit #5	T/O unit #5	
44	Wall 1st white	Living unit #5	T/O unit #5	
45	Wall 1st white	Kitchen unit #5	T/O unit #5	
46	Wall 1st white	Bathroom unit #5	T/O unit #5	
47	Wall 1st white	closet unit #5	T/O unit #5	
48	Wall 1st white	2nd fl Bedroom Bathroom unit #5	T/O unit #5	
49	VT Can	Front entry	T/O	
50	Insulation pink	west wall	attic	
51	Spout white	Kitchen unit #6	T/O unit #6	1000
52	Spout white	Kitchen unit #6	T/O unit #6	
53	Spout white	Kitchen unit #6	T/O unit #6	
54	Spout white	2nd floor entry unit #6	T/O unit #6	

6 unit

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
55	Spock white	2nd Floor Bedroom on left unit #6	T/O unit #6	
56	Spock white	2nd Floor Bedroom on right	T/O unit #6	
57	UWB m white	entry wall unit #6	T/O unit #6	
58	UWB m white	Living Wall unit #6	T/O unit #6	
59	UWB m white	Bathroom wall unit #6	T/O unit #6	
60	UWB m white	2nd Fl Hallway unit #6	T/O unit #6	
61	UWB m white	2nd Fl Bathroom unit #6	T/O unit #6	
62	UWB m white	2nd Fl Bedroom unit #6	T/O unit #6	
63	Wall <del>stone</del> white	entry unit #6	T/O unit #6	
64	Wall fxt white	Living unit #6	T/O unit #6	
65	Wall fxt white	Bathroom unit #6	T/O unit #6	
66	Wall fxt white	2nd Floor hallway unit #6	T/O unit #6	
67	Wall fxt white	2nd Fl Bedroom on left unit #6	T/O unit #6	
68	Wall fxt white	2nd Floor Bedroom on right unit #6	T/O unit #6	
69	Black Insulation	ext wall	T/O	



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB #

JS-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
70	VT Light Brown	Kitchen unit #6	Bathroom unit #6	150
71	VT Brown	entry unit #6		200
72	ceiling fast white	Bathroom unit #6	Living Room unit #6 2nd Fl Bathroom unit #6	300
73	ceiling fast white	Living unit #6	Bathroom unit #6 2nd Fl Bathroom unit #6	
74	ceiling fast white	2nd Fl Bathroom unit #6	Bathroom unit #6 Living Room unit #6	
75	Back splash mastie	Kitchen unit #6		100
76	ceramic tile white	2nd Floor Bedroom unit #6		100
77	Insulation <del>white</del> white	attic	76	
78	Spact white	entry unit #8	To unit #8	1200
79	Spact white	Living unit #8	To unit #8	
80	Spact white	Kitchen unit #8	To unit #8	
81	Spact white	2nd Floor hallway unit #8	To unit #8	
82	Spact white	2nd Floor Bedroom a left unit #8	To unit #8	
83	Spact white	2nd Floor Bedroom a right unit #8	To unit #8	
84	amb door white	Entry wall unit #8	To unit #8	

78



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB #

JJ-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
85	Unit 3 <sup>rd</sup> Trunk	LOD wall Unit #8	T/O unit #8	
86	Unit 3 Trunk white	Kitchen wall Unit #8	T/O unit #8	
87	Unit 3 white Trunk	2nd Floor Hallway Unit #8	T/O unit #8	
88	Unit 3 white Trunk	2nd Floor Bedroom Unit #8	T/O unit #8	
89	Unit 3 white Trunk	2nd Floor Bathroom Unit #8	T/O unit #8	
90	Wall 1st white	Unit #8	T/O unit #8	
91	Wall 1st white	Unit #8	T/O unit #8	
92	Wall 1st white	Kitchen Unit #8	T/O unit #8	
93	Wall 1st white	2nd Floor Bathroom Unit #8	T/O unit #8	
94	Wall 1st white	2nd Floor hallway Unit #8	T/O unit #8	
95	Wall 1st white	2nd Floor Bedroom Unit #8	T/O unit #8	
96	Insulation Block	ext wall	TC	
97	Shv - Brown Brn	Kitchen under perso Floor Unit #8		200
98	Ceramic tile Co - Tan	Kitchen Unit #8	Top layer Bathroom Unit #8	100
99	Bottom layer	Bottom layer Bathroom Unit #8		40

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB #

55-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
100	ceiling tile white	Bathroom unit #8	2nd Floor Bathroom unit #8 Closet unit #8	700
101	ceiling tile white	2nd Floor Bathroom unit #8	Bathroom unit #8 Closet unit #8	
102	ceiling tile white	closet unit #8	Bathroom unit #8 2nd Fl Bathroom unit #8	
103	Spock white	entry unit #7	T/O unit #7	1200
104	Spock white	Living unit #7	T/O unit #7	
105	Spock white	Kitchen unit #7	T/O unit #7	
106	Spock white	2nd Floor hallway unit #7	T/O unit #7	
107	Spock white	2nd Fl Bedroom on left unit #7	T/O unit #7	
108	Spock white	2nd Floor Bedroom on right unit #7	T/O unit #7	
109	Ceiling tile white	entry wall unit #7	T/O unit #7	
110	Ceiling tile white	Living wall unit #7	T/O unit #7	
111	Ceiling tile white	Kitchen wall unit #7	T/O unit #7	
112	Ceiling tile white	2nd Floor hallway unit #7	T/O unit #7	
113	Ceiling tile white	2nd Floor Bedroom on left unit #7	T/O unit #7	
114	Ceiling tile white	2nd Floor Bedroom on right unit #7	T/O unit #7	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # 55-1188

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
115	wall test white	entry unit #7	No unit #7	
116	wall test white	Kitchen unit #7	No unit #7	
117	wall test white	Living unit #7	No unit #7	
118	wall test white	2nd Floor Hallway unit #7	No unit #7	
119	wall test white	2nd Floor Bathroom unit #7	No unit #7	
120	wall test white	2nd Fl Bedroom on west unit #7	No unit #7	
121	Insulation Blue	ext wall	T/O	
122	VT Light <sup>Top</sup> Brown	Top Layer Kitchen unit #7		700
123	Bru. Brown <sup>Bottom</sup>	Bottom Layer Kitchen unit #7		1
124	concrete Material White	Kitchen unit #7	2nd Floor Bathroom unit #7	100
125	ceiling test white	Bathroom unit #7	Closet unit #7 2nd Fl Bathroom unit #7	100
126	ceiling test white	Closet unit #7	Bathroom unit #7 2nd Fl Bathroom unit #7	1
127	ceiling test white	2nd Floor Bathroom unit #7	Bathroom unit #7 Closet unit #7	1
128	Shu Gray	Bathroom unit #7		40
129	White/Green CB Brown CB	Bathroom unit #7	2nd Fl Bathroom unit #7	44

**(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633**

**LAB #**

#55-1188

[illegible]



# **ASBESTOS SURVEY**

For Building #5 located at:

**3701 ½ EAST 18<sup>TH</sup> STREET  
VANCOUVER, WASHINGTON**

Prepared for:  
Date Park Condominium, Inc.

**CERTIFIED ENVIRONMENTAL CONSULTING, LLC  
615 SE CHKALOV DRIVE SUITE 12  
VANCOUVER, WASHINGTON 98683-5280**

**Prepared by:  
Don Young  
Kyler Spears  
Eric S. Viken**

**EXECUTIVE SUMMARY**

Dear Ms. Prasad:

Enclosed are the results of the asbestos survey report conducted by C.E.C., LLC, for Building #5 located at, 3701 ½ East 18<sup>th</sup> Street, in Vancouver, Washington for demolition purposes. This survey was coordinated with you and conducted on October 1, 2024, by Kyler Spears, Don Young, and Eric S. Viken, AHERA certified inspectors. Please note that Unit #9, Unit #10, and Unit #11 are fire-damaged.

All samples were taken in a random manner as required by EPA AHERA rules and analyzed using polarized light microscopy with dispersion staining according to EPA and OR-OSHA Methodology. The samples were analyzed in C.E.C., LLC's laboratory at, 615 SE Chkalov Drive Suite #12, in Vancouver, Washington. As the asbestos samples were analyzed in our laboratory, the analytical data enclosed is the analysis report.

**Asbestos was identified in the white sprayed on ceiling texture, white sheet vinyl, brown sheet vinyl, and tan sheet vinyl (See sample data sheet attached). Please note that the asbestos containing sprayed on ceiling texture in Unit's #9, #10, and #11 are in damaged condition and maybe mixed in with building debris. Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

The following survey is divided into the following sections:


- ◇ Summary sheet - details the type and construction of the building with approximate amounts of asbestos in the building.
- ◇ Sample result sheet - contains sample numbers and results, description of materials and homogeneous areas of material.
- ◇ Assessment of materials - contains an assessment of asbestos materials.
- ◇ Response actions recommended - contains the response actions we recommend.
- ◇ Laboratory analysis sheet - contains the results of our laboratory analysis.
- ◇ Inspector's certifications.
- ◇ Photographic log.
- ◇ Asbestos chain of custody form (survey report form).

C.E.C. has investigated accessible and inaccessible areas of this facility in locating suspect ACM using destructive sampling including the interior and exterior. The current extent and condition of the ACM was detected through on-site observation and physical determination.

NOTE: This asbestos survey report is available to Date Park Condominium, Inc., and not to be reproduced in total or part without written consent of Date Park Condominium, Inc.

We appreciate the opportunity to have worked with you. If you have any questions or if we can be of any further service, please contact our office.

Sincerely,

  
Don Young  
Principal

**SUMMARY SHEET**

**Owner or Representative:** Asha Prasad

**Address:** Building #5 at, 3701 ½ East 18<sup>th</sup> Street

**City:** Vancouver      **State:** Washington

**Owner's Representative:**    Date Park Condominium, Inc.  
   Ms. Asha Prasad  
   6315 SE Evergreen Hwy  
   Vancouver, Washington 98661-7628

**Owner/Rep. Telephone Number:** (360) 600-3142

**Surveyed by:** Kyler Spears-Accreditation Number: 192139  
                         Don Young-Accreditation Number: 194365  
                         Eric S. Viken-Accreditation Number: 192140

**CONSTRUCTION DATA:**

**Year Built:** Approx.: 1950's                      **Size:** Approx. 4,000 SQ FT

**Construction Type:** Wood, Metal, Concrete

**Number of Floors:** 2

**Current/Past Use:** Multi-Family/Multi-Family

**Roof Construction:** Asphalt Shingle

**Heating System:** Electric/Baseboard

**Attic Insulation:** Fiberglass

**Pipe Insulation:** Non-Insulated

**SUMMARY DATA****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

PRODUCT	FUNCTIONAL SPACE	AMOUNT	FRIABLE	CONDITION	SAMPLE #	RESULTS
WHITE SPRAYED ON CEILING TEXTURE	UNIT #9: KITCHEN, FRONT ENTRY, LIVING ROOM, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #9 UNIT #10: LIVING ROOM, KITCHEN, FRONT ENTRY, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #10 UNIT #11: LIVING ROOM, FRONT ENTRY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #11	APPROX. 3,600 SQ FT	YES	DAMAGED DUE TO FIRE	1, 2, 3, 4, 5, 6, 34, 35, 36, 37, 38, 39, 63, 64, 65, 66, 67, 68	6% TO 7% CHRYBOTILE

Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.

Certified Environmental Consulting, LLC, warrants that the findings contained herein have been prepared in general accordance with accepted professional practices as applied by similar professionals in the community at the time of this report preparation. Changes in the state of the art or in applicable regulations cannot be anticipated and have not been addressed in this report. The field and laboratory results reported herein are considered sufficient in detail and scope to determine presence of asbestos containing materials in or around the area(s) requested at the time of the inspection. Test results are valid only for the materials tested.

There is a distinct possibility that conditions may exist that could not be identified within the scope of the inspection or that were not apparent during the site visit. This inspection covered only those areas that were exposed or physically accessible to the inspector. The inspection is limited to the information available from the client at the time of the inspection was conducted.



**SUMMARY DATA****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

PRODUCT	FUNCTIONAL SPACE	AMOUNT	FRIABLE	CONDITION	SAMPLE #	RESULTS
WHITE SPRAYED ON CEILING TEXTURE	UNIT #12: LIVING ROOM, FRONT ENTRY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #12 UNIT #13: KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOM ON LEFT, SELECTIVE THROUGHOUT UNIT #13	APPROX. 2,000 SQ FT	YES	GOOD	90, 91, 92, 93, 94, 95, 120, 121, 122,	7% <b>CHRYSTILE</b>
WHITE SHEET VINYL	STORAGE UNDER STAIRWELL UNIT #9	APPROX. 40 SQ FT	YES	DAMAGED	28	20% <b>CHRYSTILE</b>
BROWN SHEET VINYL	SECOND LAYER UNDER PERGO FLOORING KITCHEN UNIT #11	APPROX. 200 SQ FT	YES	GOOD	83	20% <b>CHRYSTILE</b>
TAN SHEET VINYL	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #13	APPROX. 40 SQ FT	YES	GOOD	146	20% <b>CHRYSTILE</b>

Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.

Certified Environmental Consulting, LLC, warrants that the findings contained herein have been prepared in general accordance with accepted professional practices as applied by similar professionals in the community at the time of this report preparation. Changes in the state of the art or in applicable regulations cannot be anticipated and have not been addressed in this report. The field and laboratory results reported herein are considered sufficient in detail and scope to determine presence of asbestos containing materials in or around the area(s) requested at the time of the inspection. Test results are valid only for the materials tested.

There is a distinct possibility that conditions may exist that could not be identified within the scope of the inspection or that were not apparent during the site visit. This inspection covered only those areas that were exposed or physically accessible to the inspector. The inspection is limited to the information available from the client at the time of the inspection was conducted.

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
1	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #9	THROUGHOUT UNIT #9 DAMAGED	6% CHRYSOTILE
2	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #9	THROUGHOUT UNIT #9 DAMAGED	6% CHRYSOTILE
3	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #9	THROUGHOUT UNIT #9 DAMAGED	6% CHRYSOTILE
4	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #9	THROUGHOUT UNIT #9 DAMAGED	6% CHRYSOTILE
5	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #9	THROUGHOUT UNIT #9 DAMAGED	6% CHRYSOTILE
6	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #9	THROUGHOUT UNIT #9 DAMAGED	6% CHRYSOTILE
7	YELLOW COUNTERTOP MATERIAL	KITCHEN UNIT #9	DAMAGED	NONE DETECTED
8	BROWN SHEET VINYL	SECOND LAYER UNDER PERGO FLOORING KITCHEN UNIT #9	DAMAGED	NONE DETECTED
9	BROWN VAPOR BARRIER	BOTTOM LAYER UNDER PERGO FLOORING KITCHEN UNIT #9	DAMAGED	NONE DETECTED
10	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
11	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
12	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY WALL UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
13	WHITE WALL TEXTURE	KITCHEN WALL UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
14	WHITE WALL TEXTURE	BATHROOM WALL UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
15	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
16	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
17	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
18	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
19	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
20	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
21	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #9	THROUGHOUT UNIT #9 DAMAGED	NONE DETECTED
22	BLACK INSULATION	EXTERIOR WALL UNIT #9	THROUGHOUT DAMAGED	NONE DETECTED
23	TAN SHEET VINYL	BATHROOM UNIT #9	DAMAGED	NONE DETECTED
24A	BLACK COVE BASE	BATHROOM UNIT #9	DAMAGED	NONE DETECTED
24B	TAN COVE BASE MASTIC	BATHROOM UNIT #9	DAMAGED	NONE DETECTED
25	WHITE CEILING TEXTURE	BATHROOM UNIT #9	CLOSET UNIT #9, SECOND FLOOR BATHROOM UNIT #9 DAMAGED	NONE DETECTED
26	WHITE CEILING TEXTURE	CLOSET UNIT #9	BATHROOM UNIT #9, SECOND FLOOR BATHROOM UNIT #9 DAMAGED	NONE DETECTED
27	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #9	BATHROOM UNIT #9, CLOSET UNIT #9 DAMAGED	NONE DETECTED
28	WHITE SHEET VINYL	STORAGE UNDER STAIRWELL UNIT #9	DAMAGED	20% CHRYSOTILE
29	WHITE/PINK INSULATION	ATTIC	THROUGHOUT DAMAGED	NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
30	YELLOW CARPET MASTIC	SECOND FLOOR UNDER PERGO FLOORING UNIT #9	DAMAGED	NONE DETECTED
31A	BROWN COVE BASE	SECOND FLOOR BATHROOM UNIT #9	DAMAGED	NONE DETECTED
31B	TAN COVE BASE MASTIC	SECOND FLOOR BATHROOM UNIT #9	DAMAGED	NONE DETECTED
32	TAN SHOWER SURROUND	SECOND FLOOR BATHROOM UNIT #9	DAMAGED	NONE DETECTED
33	WHITE COUNTERTOP MATERIAL	KITCHEN UNIT #10	DAMAGED	NONE DETECTED
34	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #10	THROUGHOUT UNIT #10 DAMAGED	7% CHRYSOTILE
35	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #10	THROUGHOUT UNIT #10 DAMAGED	7% CHRYSOTILE
36	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #10	THROUGHOUT UNIT #10 DAMAGED	7% CHRYSOTILE
37	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #10	THROUGHOUT UNIT #10 DAMAGED	7% CHRYSOTILE
38	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #10	THROUGHOUT UNIT #10 DAMAGED	7% CHRYSOTILE
39	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #10	THROUGHOUT UNIT #10 DAMAGED	7% CHRYSOTILE
40	WHITE WALL TEXTURE	LIVING ROOM UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
41	WHITE WALL TEXTURE	FRONT ENTRY UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
42	WHITE WALL TEXTURE	KITCHEN UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
43	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED



**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
44	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM WALL UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
45	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
46	WHITE WALL TEXTURE	LIVING ROOM UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
47	WHITE WALL TEXTURE	BATHROOM UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
48	WHITE WALL TEXTURE	KITCHEN UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
49	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT#10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
50	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
51	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
52	BLACK INSULATION	EXTERIOR WALL UNIT #10	THROUGHOUT UNIT #10 DAMAGED	NONE DETECTED
53	GRAY VINYL TILE	TOP LAYER KITCHEN UNIT #10	DAMAGED	NONE DETECTED
54	BROWN VAPOR BARRIER	BOTTOM LAYER KITCHEN UNIT #10	DAMAGED	NONE DETECTED
55	TAN VINYL TILE	BATHROOM UNIT #10	DAMAGED	NONE DETECTED
56A	WHITE COVE BASE	BATHROOM UNIT #10	DAMAGED	NONE DETECTED
56B	TAN COVE BASE MASTIC	BATHROOM UNIT #10	DAMAGED	NONE DETECTED
57	WHITE CEILING TEXTURE	BATHROOM UNIT #10	SECOND FLOOR BATHROOM UNIT #10, CLOSET UNIT #10 DAMAGED	NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
58	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #10	BATHROOM UNIT #10, CLOSET UNIT #10 DAMAGED	NONE DETECTED
59	WHITE CEILING TEXTURE	CLOSET UNIT #10	BATHROOM UNIT #10, SECOND FLOOR BATHROOM UNIT #10 DAMAGED	NONE DETECTED
60	PINK/WHITE INSULATION	ATTIC	THROUGHOUT DAMAGED	NONE DETECTED
61	TAN SHEET VINYL	SECOND FLOOR BATHROOM UNIT #10	DAMAGED	NONE DETECTED
62	GRAY WIRE INSULATION	ATTIC	DAMAGED THROUGHOUT	NONE DETECTED
63	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #11	THROUGHOUT UNIT #11 DAMAGED	7% CHRYSOTILE
64	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #11	THROUGHOUT UNIT #11 DAMAGED	7% CHRYSOTILE
65	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #11	THROUGHOUT UNIT #11 DAMAGED	7% CHRYSOTILE
66	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #11	THROUGHOUT UNIT #11 DAMAGED	7% CHRYSOTILE
67	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #11	THROUGHOUT UNIT #11 DAMAGED	7% CHRYSOTILE
68	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #11	THROUGHOUT UNIT #11 DAMAGED	7% CHRYSOTILE
69	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
70	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
71	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM WALL UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
72	WHITE WALL TEXTURE	LIVING ROOM UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
73	WHITE WALL TEXTURE	KITCHEN UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
74	WHITE WALL TEXTURE	BATHROOM UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
75	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
76	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
77	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
78	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
79	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
80	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #11	THROUGHOUT UNIT #11 DAMAGED	NONE DETECTED
81	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT DAMAGED	NONE DETECTED
82	TAN/GRAY CERAMIC TILE WITH GROUT	AS COUNTERTOP KITCHEN UNIT #11	SECOND FLOOR BATHROOM UNIT #11	NONE DETECTED
83	BROWN SHEET VINYL	SECOND LAYER UNDER PERGO FLOORING KITCHEN UNIT #11	UNIT IS DAMAGED	20% CHRYSOTILE
84	BROWN VAPOR BARRIER	BOTTOM LAYER UNDER PERGO FLOORING KITCHEN UNIT #11	UNIT IS DAMAGED	NONE DETECTED
85	TAN SHEET VINYL	BATHROOM UNIT #11	DAMAGED	NONE DETECTED
86	WHITE CEILING TEXTURE	BATHROOM UNIT #11	CLOSET UNIT #11, SECOND FLOOR BATHROOM UNIT #11 DAMAGED	NONE DETECTED
87	WHITE CEILING TEXTURE	CLOSET UNIT #11	BATHROOM UNIT #11, SECOND FLOOR BATHROOM UNIT #11 DAMAGED	NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
88	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #11	BATHROOM UNIT #11, CLOSET UNIT #11, DAMAGED	NONE DETECTED
89	PINK/WHITE INSULATION	ATTIC	THROUGHOUT DAMAGED	NONE DETECTED
90	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #12	THROUGHOUT UNIT #12	7% CHRYSOTILE
91	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #12	THROUGHOUT UNIT #12	7% CHRYSOTILE
92	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #12	THROUGHOUT UNIT #12	7% CHRYSOTILE
93	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #12	THROUGHOUT UNIT #12	7% CHRYSOTILE
94	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #12	THROUGHOUT UNIT #12	7% CHRYSOTILE
95	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #12	THROUGHOUT UNIT #12	7% CHRYSOTILE
96	WHITE WALL TEXTURE	FRONT ENTRY UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
97	WHITE WALL TEXTURE	LIVING ROOM UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
98	WHITE WALL TEXTURE	KITCHEN UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
99	WHITE WALL TEXTURE	HALLWAY UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
100	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
101	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
102	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY WALL UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED



**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
103	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
104	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
105	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
106	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #12	THROUGHOUT UNIT #12	NONE DETECTED
107	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT	THROUGHOUT UNIT #12	NONE DETECTED
108	BROWN SHEET VINYL	TOP LAYER KITCHEN UNIT #12		NONE DETECTED
109	BROWN VAPOR BARRIER	BOTTOM LAYER KITCHEN UNIT #12		NONE DETECTED
110	TAN CERAMIC TILE WITH GROUT	KITCHEN UNIT #12		NONE DETECTED
111	GRAY CERAMIC TILE WITH GROUT	SECOND FLOOR BATHROOM UNIT #12		NONE DETECTED
112	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #12	BATHROOM UNIT #12, CLOSET UNIT #12	NONE DETECTED
113	WHITE CEILING TEXTURE	BATHROOM UNIT #12	SECOND FLOOR BATHROOM UNIT #12, CLOSET UNIT #12	NONE DETECTED
114	WHITE CEILING TEXTURE	CLOSET UNIT #12	SECOND FLOOR BATHROOM UNIT #12, BATHROOM UNIT #12	NONE DETECTED
115	BLACK INSULATION	EXTERIOR WALL UNIT #12	THROUGHOUT	NONE DETECTED
116	PINK/WHITE INSULATION	ATTIC UNIT #12	THROUGHOUT	NONE DETECTED
117	WHITE CEILING TEXTURE	LIVING ROOM UNIT #13		NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

SAMPLE #	SAMPLE DESCRIPTION	SAMPLE LOCATION	HOMOGENEOUS AREA	ASBESTOS CONTENT
118	WHITIE CEILING TEXTURE	LIVING ROOM UNIT #13		NONE DETECTED
119	WHITE CEILING TEXTURE	LIVING ROOM UNIT #13		NONE DETECTED
120	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #13	SELECTIVE THROUGHOUT UNIT #13	7% CHRYSOTILE
121	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #13	SELECTIVE THROUGHOUT UNIT #13	7% CHRYSOTILE
122	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #13	SELECTIVE THROUGHOUT UNIT #13	7% CHRYSOTILE
123	WHITE CEILING TEXTURE	BATHROOM UNIT #13	CLOSET UNIT #13, SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED
124	WHITE CEILING TEXTURE	CLOSET UNIT #13	BATHROOM UNIT #13, SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED
125	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #13	BATHROOM UNIT #13, SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED
126	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
127	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
128	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY WALL UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
129	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
130	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
131	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON RIGHT UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
132	WHITE WALL TEXTURE	LIVING ROOM UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
133	WHITE WALL TEXTURE	FRONT ENTRY UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
134	WHITE WALL TEXTURE	BATHROOM UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED

**SAMPLE RESULTS****BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

<b>SAMPLE #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>HOMOGENEOUS AREA</b>	<b>ASBESTOS CONTENT</b>
135	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
136	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
137	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #13	THROUGHOUT UNIT #13	NONE DETECTED
138	BLACK INSULATION	EXTERIOR WALL	THROUGHOUT	NONE DETECTED
139	YELLOW COUNTERTOP MATERIAL	KITCHEN UNIT #13		NONE DETECTED
140	WHITE SHEET VINYL BACKING	UNDER PERGO FLOORING KITCHEN UNIT #13		NONE DETECTED
141	WHITE SHEET VINYL	TOP LAYER BATHROOM UNIT #13	CLOSET UNIT #13	NONE DETECTED
142	BROWN VAPOR BARRIER	BOTTOM LAYER BATHROOM UNIT #13		NONE DETECTED
143	WHITE SHEET VINYL BACKING	UNDER PERGO FLOORING FRONT ENTRY UNIT #13		NONE DETECTED
144	TAN CERAMIC TILE WITH GROUT	TOP LAYER SECOND FLOOR BATHROOM UNIT #13		NONE DETECTED
145	GRAY BACKERBOARD	SECOND LAYER SECOND FLOOR BATHROOM UNIT #13		NONE DETECTED
146	TAN SHEET VINYL	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #13		20% CHRYSOTILE
147	BROWN FIBERBOARD	UNDER EXTERIOR SIDING	THROUGHOUT	NONE DETECTED
148	BLACK ASPHALT SHINGLE	TOP LAYER ROOF	ENTIRE ROOF	NONE DETECTED
149	BLACK ASPHALT SHINGLE	SECOND LAYER ROOF	ENTIRE ROOF	NONE DETECTED
150	BLACK ASPHALT SHINGLE	THIRD LAYER ROOF	ENTIRE ROOF	NONE DETECTED
151	BLACK TAR PAPER	BOTTOM LAYER ROOF	ENTIRE ROOF	NONE DETECTED


**ASSESSMENT OF MATERIALS****Building: BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

Sample #s	Functional Space	Asbestos Type	%	Material And Condition	Comments	Sq. Ft. And/or Linear Footage
1, 2, 3, 4, 5, 6, 34, 35, 36, 37, 38, 39, 63, 64, 65, 66, 67, 68	UNIT #9: KITCHEN, FRONT ENTRY, LIVING ROOM, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #9 UNIT #10: LIVING ROOM, KITCHEN, FRONT ENTRY, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #10 UNIT #11: LIVING ROOM, FRONT ENTRY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #11	CHRYSTILE	6% TO 7%	WHITE SPRAYED ON CEILING TEXTURE (DAMAGED)	DAMAGED DUE TO FIRE	APPROX. 3,600 SQ FT

**Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

**Inspector: Kyler Spears- Accreditation Number: 192139**

Signature: \_\_\_\_\_

Date: October 21, 2024



**ASSESSMENT OF MATERIALS****Building: BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER, WASHINGTON**

Sample #s	Functional Space	Asbestos Type	%	Material And Condition	Comments	Sq. Ft. And/or Linear Footage
90, 91, 92, 93, 94, 95, 120, 121, 122,	UNIT #12: LIVING ROOM, FRONT ENTRY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #12 UNIT #13: KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOM ON LEFT, SELECTIVE THROUGHOUT UNIT #13	CHRYSTILE	7%	WHITE SPRAYED ON CEILING TEXTURE (GOOD)	SEE RESPONSE ACTIONS	APPROX. 2,000 SQ FT
28	STORAGE UNDER STAIRWELL UNIT #9	CHRYSTILE	20%	WHITE SHEET VINYL (DAMAGED)	DAMAGED	APPROX. 40 SQ FT
83	SECOND LAYER UNDER PERGO FLOORING KITCHEN UNIT #11	CHRYSTILE	20%	BROWN SHEET VINYL (GOOD)	SEE RESPONSE ACTIONS	APPROX. 200 SQ FT
146	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #13	CHRYSTILE	20%	TAN SHEET VINYL (GOOD)	SEE RESPONSE ACTIONS	APPROX. 40 SQ FT

**Please note: the quantities and/or amounts listed within (Summary Data, Assessment of Materials sections) are estimates only and are not to be relied upon for estimating the removal costs. All quantities and/or amounts should be field verified by the responsible parties for the true amounts and removal costs.**

**Inspector: Kyler Spears- Accreditation Number: 192139**Signature: Date: October 25, 2024


**RESPONSE ACTIONS RECOMMENDED**

Building: **BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER,  
WASHINGTON**

MATERIAL	LOCATION	RECOMMENDED RESPONSE ACTIONS
SPRAYED ON CEILING TEXTURE (WHITE)	UNIT #9: KITCHEN, FRONT ENTRY, LIVING ROOM, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #9 UNIT #10: LIVING ROOM, KITCHEN, FRONT ENTRY, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #10 UNIT #11: LIVING ROOM, FRONT ENTRY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #11	Sprayed on ceiling texture is currently in damaged condition due to fire and needs to be removed to prevent area and personnel from being exposed to asbestos fiber release episodes. Asbestos containing sprayed on ceiling texture could be mixed in with other building debris. Must be removed prior to renovation or demolition.

**Management Planner: Don Young - Accreditation Number: 194564**

**Signature:** \_\_\_\_\_

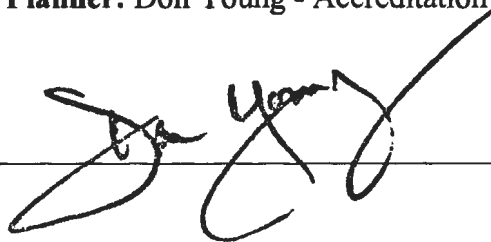

**Date** October 25, 2024


**RESPONSE ACTIONS RECOMMENDED**

Building: **BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup> STREET, VANCOUVER,  
WASHINGTON**

MATERIAL	LOCATION	RECOMMENDED RESPONSE ACTIONS
SPRAYED ON CEILING TEXTURE (WHITE)	UNIT #12: LIVING ROOM, FRONT ENTRY, KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOMS ON LEFT AND RIGHT, THROUGHOUT UNIT #12 UNIT #13: KITCHEN, SECOND FLOOR HALLWAY, SECOND FLOOR BEDROOM ON LEFT, SELECTIVE THROUGHOUT UNIT #13	Sprayed on ceiling texture is a friable material, which is currently in good condition and poses no health risk in its current state. It is important to keep it encapsulated with a high vehicular latex paint. Do not sand on, drill through, remove, or otherwise disturb material. Must be removed prior to renovation or demolition.
SHEET VINYL (WHITE)	STORAGE UNDER STAIRWELL UNIT #9	Sheet vinyl is a friable material currently in damaged condition as it is not secured to the floor and can be easily torn. Do not disturb material. Must be removed prior to renovation or demolition.
SHEET VINYL (BROWN, TAN)	SECOND LAYER UNDER PERGO FLOORING UNIT #11, BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #13	Sheet vinyl is a friable material currently in good condition and poses no health hazards in its present state. Do not drill through, sand on, tear, remove, or otherwise disturb material. Must be removed prior to renovation or demolition.

**Management Planner: Don Young - Accreditation Number: 194564**

Signature: \_\_\_\_\_

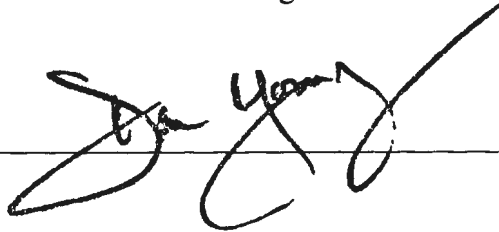

Date October 25, 2024

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
1	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #9	6% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
2	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #9	6% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
3	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #9	6% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
4	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #9	6% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
5	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #9	6% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
6	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #9	6% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
7	YELLOW COUNTERTOP MATERIAL	KITCHEN UNIT #9	NONE DETECTED	55% CELLULOSE, FORMICA, EPOXY, ADHESIVE
8	BROWN SHEET VINYL	SECOND LAYER UNDER PERGO FLOORING KITCHEN UNIT #9	NONE DETECTED	15% FIBERGLASS, 10% CELLULOSE, VINYL, CALCITE, ADHESIVE
9	BROWN VAPOR BARRIER	BOTTOM LAYER UNDER PERGO FLOORING KITCHEN UNIT #9	NONE DETECTED	65% CELLULOSE, TAR, ADHESIVE
10	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #9	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
11	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #9	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
12	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY WALL UNIT #9	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
13	WHITE WALL TEXTURE	KITCHEN WALL UNIT #9	NONE DETECTED	CALCIUM CARBONATE, BINDER
14	WHITE WALL TEXTURE	BATHROOM WALL UNIT #9	NONE DETECTED	CALCIUM CARBONATE, BINDER
15	WHITE WALL TEXTURE	LIVING ROOM WALL UNIT #9	NONE DETECTED	CALCIUM CARBONATE, BINDER
16	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #9	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
17	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #9	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
18	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #9	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
19	WHITE WALL TEXTURE	SECOND FLOOR HALL WAY UNIT #9	NONE DETECTED	CALCIUM CARBONATE, BINDER
20	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #9	NONE DETECTED	CALCIUM CARBONATE, BINDER
21	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #9	NONE DETECTED	CALCIUM CARBONATE, BINDER
22	BLACK INSULATION	EXTERIOR WALL UNIT #9	NONE DETECTED	80% FIBERGLASS, DEBRIS
23	TAN SHEET VINYL	BATHROOM UNIT #9	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
24A	BLACK COVE BASE	BATHROOM UNIT #9	NONE DETECTED	SILICONE CEMENT, ADHESIVE
24B	TAN COVE BASE MASTIC	BATHROOM UNIT #9	NONE DETECTED	CLAY, ADHESIVE, BINDER

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
25	WHITE CEILING TEXTURE	BATHROOM UNIT #9	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
26	WHITE CEILING TEXTURE	CLOSET UNIT #9	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
27	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #9	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
28	WHITE SHEET VINYL	STORAGE UNDER STAIRWELL UNIT #9	20% CHRYSOTILE	10% CELLULOSE, VINYL, CALCITE, ADHESIVE
29	WHITE/PINK INSULATION	ATTIC	NONE DETECTED	80% FIBERGLASS, DEBRIS
30	YELLOW CARPET MASTIC	UNDER PERGO SECOND FLOOR UNIT #9	NONE DETECTED	3% CELLULOSE, CLAY, ADHESIVE, BINDER

**ANALYST:** DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
31A	BROWN COVE BASE	SECOND FLOOR BATHROOM UNIT #9	NONE DETECTED	SILICONE CEMENT, ADHESIVE
31B	TAN COVE BASE MASTIC	SECOND FLOOR BATHROOM UNIT #9	NONE DETECTED	CLAY, ADHESIVE
32	TAN SHOWER SURROUND	SECOND FLOOR BATHROOM UNIT #9	NONE DETECTED	55% FIBERGLASS, VINYL, ADHESIVE
33	WHITE COUNTERTOP MATERIAL	KITCHEN UNIT #10	NONE DETECTED	55% CELLULOSE, FORMICA, VINYL, EPOXY, ADHESIVE
34	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #10	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
35	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #10	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
36	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #10	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
37	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #10	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
38	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #10	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
39	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #10	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
40	WHITE WALL TEXTURE	LIVING ROOM UNIT #10	NONE DETECTED	CALCIUM CARBONATE, BINDER
41	WHITE WALL TEXTURE	FRONT ENTRY UNIT #10	NONE DETECTED	CALCIUM CARBONATE, BINDER
42	WHITE WALL TEXTURE	KITCHEN UNIT #10	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
43	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #10	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
44	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM WALL UNIT #10	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
45	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #10	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
46	WHITE WALL TEXTURE	LIVING ROOM UNIT #10	NONE DETECTED	CALCIUM CARBONATE, BINDER
47	WHITE WALL TEXTURE	BATHROOM UNIT #10	NONE DETECTED	CALCIUM CARBONATE, BINDER
48	WHITE WALL TEXTURE	KITCHEN UNIT #10	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.**MS. ASHA PRASAD**  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1170/24-230  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

<b>SAMPLE ID #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>ASBESTOS CONTENT</b>	<b>OTHER MATERIAL</b>
49	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #10	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
50	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #10	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
51	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM CEILING UNIT #10	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
52	BLACK INSULATION	EXTERIOR WALL UNIT #10	NONE DETECTED	70% FIBERGLASS, DEBRIS, TAR
53	GRAY VINYL TILE	TOP LAYER KITCHEN UNIT #10	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
54	BROWN VAPOR BARRIER	BOTTOM LAYER KITCHEN UNIT #10	NONE DETECTED	65% CELLULOSE, TAR

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

<b>SAMPLE ID #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>ASBESTOS CONTENT</b>	<b>OTHER MATERIAL</b>
55	TAN VINYL TILE	BATHROOM UNIT #10	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, VINYL, BINDER, ADHESIVE
56A	WHITE COVE BASE	BATHROOM UNIT #10	NONE DETECTED	SILICONE CEMENT, ADHESIVE
56B	TAN COVE BASE MASTIC	BATHROOM UNIT #10	NONE DETECTED	CLAY, ADHESIVE
57	WHITE CEILING TEXTURE	BATHROOM UNIT #10	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
58	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #10	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
59	WHITE CEILING TEXTURE	CLOSET UNIT #10	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
60	PINK/WHITE INSULATION	ATTIC	NONE DETECTED	80% FIBERGLASS, DEBRIS

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
61	TAN SHEET VINYL	SECOND FLOOR BATHROOM UNIT #10	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE
62	GRAY WIRE INSULATION	ATTIC	NONE DETECTED	30% CELLULOSE, 20% FIBERGLASS, TAR, PAINT
63	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
64	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
65	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
66	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
67	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
68	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
69	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #11	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
70	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #11	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
71	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	BATHROOM WALL UNIT #11	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
72	WHITE WALL TEXTURE	LIVING ROOM UNIT #11	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
73	WHITE WALL TEXTURE	KITCHEN UNIT #11	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
74	WHITE WALL TEXTURE	BATHROOM UNIT #11	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
75	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #11	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
76	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #11	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
77	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT CEILING UNIT #11	NONE DETECTED	15% CELLULOSE, 3% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
78	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #11	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1188/24-236  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
79	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM CEILING UNIT #11	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
80	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #11	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
81	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, DEBRIS, TAR
82	TAN/GRAY CERAMIC TILE WITH GROUT	AS COUNTERTOP KITCHEN UNIT #11	NONE DETECTED	CLAY, SAND, CEMENT, AGGREGATE, CERAMIC
83	BROWN SHEET VINYL	SECOND LAYER UNDER PERGO FLOORING KITCHEN UNIT #11	20% CHRYSOTILE	5% CELLULOSE, VINYL, CALCITE, ADHESIVE
84	BROWN VAPOR BARRIER	BOTTOM LAYER UNDER PERGO FLOORING KITCHEN UNIT #11	NONE DETECTED	65% CELLULOSE, TAR

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
85	TAN SHEET VINYL	BATHROOM UNIT #11	NONE DETECTED	20% FIBERGLASS, VINYL, CALCITE, ADHESIVE
86	WHITE CEILING TEXTURE	BATHROOM UNIT #11	NONE DETECTED	CALCIUM CARBONATE, BINDER
87	WHITE CEILING TEXTURE	CLOSET UNIT #11	NONE DETECTED	CALCIUM CARBONATE, BINDER
88	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #11	NONE DETECTED	CALCIUM CARBONATE, BINDER
89	PINK/WHITE INSULATION	ATTIC	NONE DETECTED	80% FIBERGLASS, DEBRIS
90	WHITE SPRAYED ON CEILING TEXTURE	LIVING ROOM UNIT #12	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:** **REVIEWED BY:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
91	WHITE SPRAYED ON CEILING TEXTURE	FRONT ENTRY UNIT #12	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
92	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #12	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
93	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #12	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
94	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
95	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #11	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
96	WHITE WALL TEXTURE	FRONT ENTRY UNIT #12	NONE DETECTED	CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
97	WHITE WALL TEXTURE	LIVING ROOM UNIT #12	NONE DETECTED	CALCIUM CARBONATE, BINDER
98	WHITE WALL TEXTURE	KITCHEN UNIT #12	NONE DETECTED	CALCIUM CARBONATE, BINDER
99	WHITE WALL TEXTURE	HALLWAY UNIT #12	NONE DETECTED	CALCIUM CARBONATE, BINDER
100	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #12	NONE DETECTED	CALCIUM CARBONATE, BINDER
101	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #12	NONE DETECTED	CALCIUM CARBONATE, BINDER
102	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY WALL UNIT #12	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:** DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1170/24-230  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
103	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #12	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
104	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #12	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
105	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY UNIT #12	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
106	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM UNIT #12	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
107	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON LEFT UNIT #12	NONE DETECTED	15% CELLULOSE, 10% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
108	BROWN SHEET VINYL	TOP LAYER KITCHEN UNIT #12	NONE DETECTED	20% CELLULOSE, VINYL, CALCITE, ADHESIVE

**ANALYST:** DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
109	BROWN VAPOR BARRIER	BOTTOM LAYER KITCHEN UNIT #12	NONE DETECTED	65% CELLULOSE, TAR
110	TAN CERAMIC TILE WITH GROUT	KITCHEN UNIT #12	NONE DETECTED	CLAY, SAND, CERAMIC, AGGREGATE, CEMENT
111	GRAY CERAMIC TILE WITH GROUT	SECOND FLOOR BATHROOM UNIT #12	NONE DETECTED	CLAY, SAND, CERAMIC, AGGREGATE, CEMENT
112	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #12	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
113	WHITE CEILING TEXTURE	BATHROOM UNIT #12	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
114	WHITE CEILING TEXTURE	CLOSET UNIT #12	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:**

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1170/24-230  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
115	BLACK INSULATION	EXTERIOR WALL UNIT #12	NONE DETECTED	60% FIBERGLASS, DEBRIS, TAR
116	PINK/WHITE INSULATION	ATTIC UNIT #12	NONE DETECTED	80% FIBERGLASS, DEBRIS
117	WHITE CEILING TEXTURE	LIVING ROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
118	WHITE CEILING TEXTURE	LIVING ROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
119	WHITE CEILING TEXTURE	LIVING ROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
120	WHITE SPRAYED ON CEILING TEXTURE	KITCHEN UNIT #13	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER

**ANALYST:** **REVIEWED BY:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
121	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR HALLWAY UNIT #13	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
122	WHITE SPRAYED ON CEILING TEXTURE	SECOND FLOOR BEDROOM ON LEFT UNIT #13	7% CHRYSOTILE	3% CELLULOSE, CALCIUM CARBONATE, SYNTHETIC FOAM, BINDER
123	WHITE CEILING TEXTURE	BATHROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
124	WHITE CEILING TEXTURE	CLOSET UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
125	WHITE CEILING TEXTURE	SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
126	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	KITCHEN WALL UNIT #13	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 



**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #4 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1188/24-236**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
127	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	LIVING ROOM WALL UNIT #13	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
128	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	FRONT ENTRY WALL UNIT #13	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
129	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR HALLWAY CEILING UNIT #13	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
130	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BATHROOM CEILING UNIT #13	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
131	WHITE GYPSUM WALLBOARD WITH TAPE AND MUD	SECOND FLOOR BEDROOM ON RIGHT CEILING UNIT #13	NONE DETECTED	15% CELLULOSE, 5% FIBERGLASS, CALCIUM SULFATE, CALCIUM CARBONATE, BINDER
132	WHITE WALL TEXTURE	LIVING ROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER

**ANALYST:** DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
133	WHITE WALL TEXTURE	FRONT ENTRY UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
134	WHITE WALL TEXTURE	BATHROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
135	WHITE WALL TEXTURE	SECOND FLOOR HALLWAY UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
136	WHITE WALL TEXTURE	SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
137	WHITE WALL TEXTURE	SECOND FLOOR BEDROOM ON RIGHT UNIT #13	NONE DETECTED	3% CELLULOSE, CALCIUM CARBONATE, BINDER
138	BLACK INSULATION	EXTERIOR WALL	NONE DETECTED	60% FIBERGLASS, TAR, DEBRIS

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.**SOURCE:** BUILDING #5 AT, 3701 ½ EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTONMS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN  
**LAB/JOB #:** JJ-1170/24-230  
**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24**ANALYTICAL METHOD:** EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

<b>SAMPLE ID #</b>	<b>SAMPLE DESCRIPTION</b>	<b>SAMPLE LOCATION</b>	<b>ASBESTOS CONTENT</b>	<b>OTHER MATERIAL</b>
139	YELLOW COUNTERTOP MATERIAL	KITCHEN UNIT #13	NONE DETECTED	55% CELLULOSE, FORMICA, EPOXY, ADHESIVE
140	WHITE SHEET VINYL BACKING	SECOND LAYER UNDER PERGO KITCHEN UNIT #13	NONE DETECTED	30% FIBERGLASS, CALCITE, ADHESIVE
141	WHITE SHEET VINYL	TOP LAYER BATHROOM UNIT #13	NONE DETECTED	15% FIBERGLASS, VINYL, ADHESIVE
142	BROWN VAPOR BARRIER	BOTTOM LAYER BATHROOM UNIT #13	NONE DETECTED	65% CELLULOSE, TAR
143	WHITE SHEET VINYL BACKING	SECOND LAYER UNDER PERGO FLOORING FRONT ENTRY UNIT #13	NONE DETECTED	30% CELLULOSE, CALCITE, ADHESIVE
144	TAN CERAMIC TILE WITH GROUT	TOP LAYER SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED	CLAY, SAND, CEMENT, CERAMIC, AGGREGATE

**ANALYST:** 

DEVIATION FROM METHOD: NONE.

PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:** 

**SAMPLE ANALYSIS REPORT****CLIENT:** DATE PARK CONDOMINIUM, INC.MS. ASHA PRASAD  
6315 SE EVERGREEN HWY  
VANCOUVER, WASHINGTON 98661-7628**SOURCE:** BUILDING #5 AT, 3701 1/2 EAST 18<sup>TH</sup>  
STREET, VANCOUVER, WASHINGTON**SAMPLED BY:** KYLER SPEARS/ERIC S. VIKEN**LAB/JOB #:** JJ-1170/24-230**ANALYZED BY:** KYLER SPEARS**DATE SAMPLED:** 10-01-24**DATE RECEIVED:** 10-01-24**DATE COMPLETED:** 10-09-24ANALYTICAL METHOD: EPA 600/R-93/116, 40 CFR Part 763, Subpart E, Appendix E, Section 1,  
PLM/Dispersion Staining

SAMPLE ID #	SAMPLE DESCRIPTION	SAMPLE LOCATION	ASBESTOS CONTENT	OTHER MATERIAL
145	GRAY BACKERBOARD	SECOND LAYER SECOND FLOOR BATHROOM UNIT #13	NONE DETECTED	30% CELLULOSE, CEMENT, AGGREGATE, CLAY
146	TAN SHEET VINYL	BOTTOM LAYER SECOND FLOOR BATHROOM UNIT #13	20% CHRYSOTILE	3% CELLULOSE, VINYL, CALCITE, ADHESIVE
147	BROWN FIBERBOARD	UNDER EXTERIOR SIDING	NONE DETECTED	55% CELLULOSE, WOOD, ADHESIVE, BINDER
148	BLACK ASPHALT SHINGLE	TOP LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
149	BLACK ASPHALT SHINGLE	SECOND LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
150	BLACK ASPHALT SHINGLE	THIRD LAYER ROOF	NONE DETECTED	25% FIBERGLASS, TAR, AGGREGATE
151	BLACK TAR PAPER	BOTTOM LAYER ROOF	NONE DETECTED	65% CELLULOSE, TAR, ADHESIVE, DEBRIS

**ANALYST:**DEVIATION FROM METHOD: NONE.  
PERCENTAGES ARE ESTIMATES.

TEST RESULTS PERTAIN ONLY TO ITEMS TESTED.

\* DETECTION LIMIT IS LESS THAN 1% ASBESTOS.

NON-ASBESTOS MATERIALS ARE NOT NECESSARILY LISTED.

**REVIEWED BY:**



## Certificate of Completion

This is to certify that


**Kyler J.M. Spears**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

192139  
Certificate Number



Instructor: Tracy Bockla

Dec 27, 2023

Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON TRAINING CENTER 615 SE CHKALOV DRIVE SUITE 12 VANCOUVER, WASHINGTON 98683-5280 TEL: (360) 221-7904 FAX: (360) 891-9633 ARGUSPACIFIC.COM

## Certificate of Completion

This is to certify that  
**Don E. Young**  
has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector  
to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)  
EPA Provider # 1085

194365  
Certificate Number

  
Instructor: Tracy Bookla

Jul 11, 2024 Expires in 1 year.  
Date(s) of Training  
Exam Score: N/A  
(If applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON ENVIRONMENTAL CONSULTING, LLC, 10000 15TH AVE SW, SUITE 100, BELLEVUE, WASHINGTON 98003

## Certificate of Completion

This is to certify that  
**Don E. Young**  
has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Management Planner  
to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)  
EPA Provider # 1085

194564  
Certificate Number

  
Instructor: David Welch

Jul 31, 2024 Expires in 1 year.  
Date(s) of Training  
Exam Score: N/A  
(If applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON ENVIRONMENTAL CONSULTING, LLC, 10000 15TH AVE SW, SUITE 100, BELLEVUE, WASHINGTON 98003

TERRACON ENVIRONMENTAL CONSULTING, LLC

## Certificate of Completion

This is to certify that


**Eric S. Viken**

has satisfactorily completed  
4 hours of online refresher training as an  
AHERA Building Inspector

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

192140  
Certificate Number



Instructor: Tracy Bockla

Dec 27, 2023

Expires in 1 year.

Date(s) of Training

Exam Score: N/A  
(if applicable)



- Facilities
- Environmental
- Geotechnical
- Materials

TERRACON TRAINING - FORMERLY ARGUS PACIFIC / 21305 FAITH WAY, N.E., SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.295.1171 / ARGUSPACIFIC.COM


**PHOTOGRAPHIC LOG**





*1,2,3  
4,5,6  
popcorn ceiling texture*



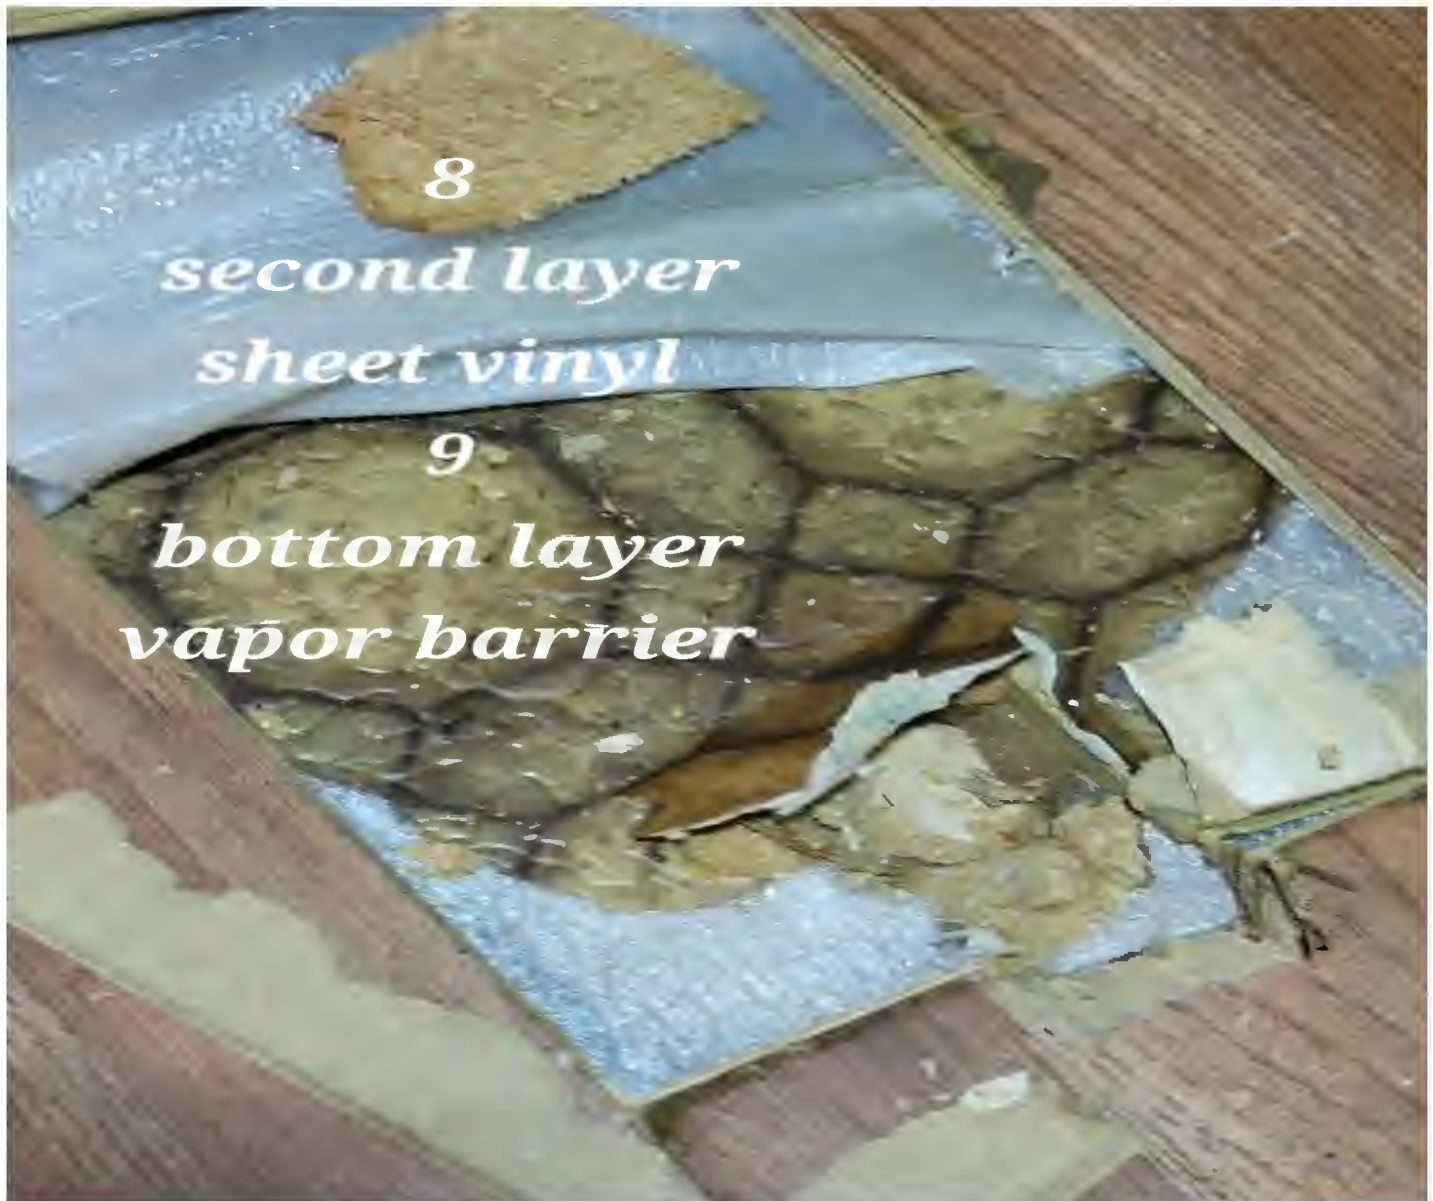










































*57,58,59*  
*ceiling texture*




























**86,87,88**  
*ceiling texture*


















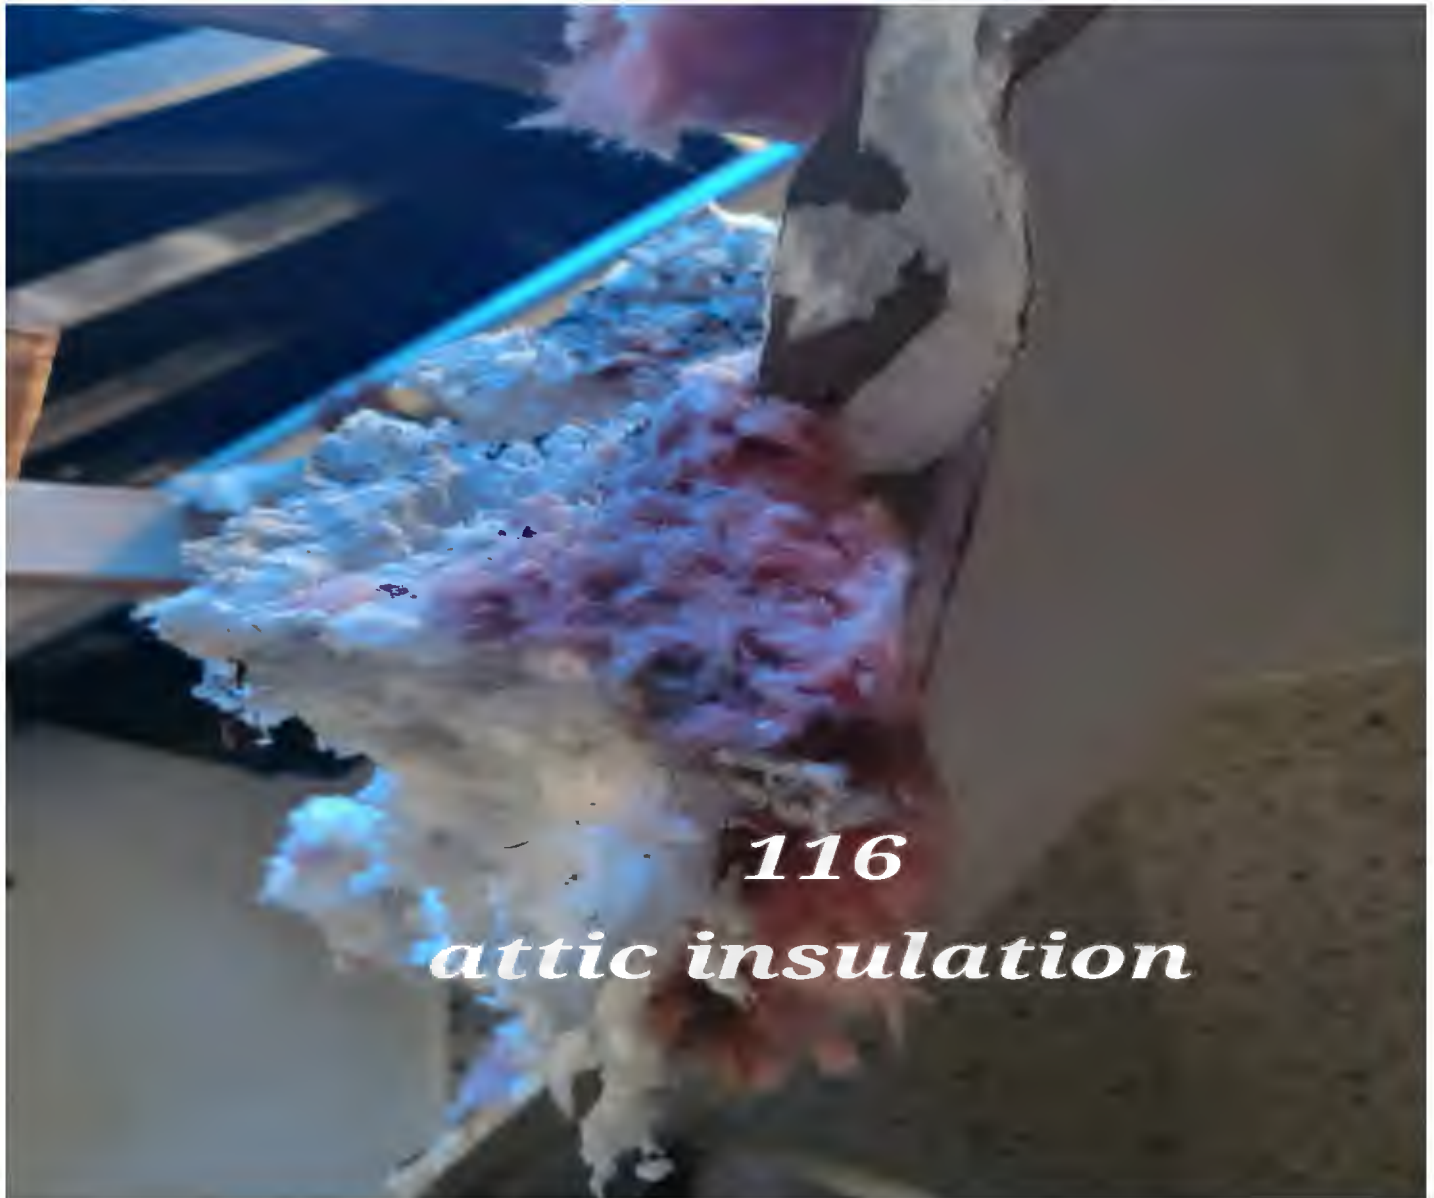






***112,113,114***  
***ceiling texture***










***117,118,119***  
***ceiling texture***





*120,121,122*  
*popcorn ceiling texture*

























# CERTIFIED ENVIRONMENTAL CONSULTING, LLC.

## SURVEY REPORT

DATE: 10-1 SAMPLED BY: K-EV COST/QUOTE \$ \_\_\_\_\_ LAB # 1170  
 PO#/JOB # 29-230

CLIENT: Date Park Condominium, Inc. CONTACT: Asha Prasad

BILLING ADDRESS: \_\_\_\_\_ CITY/STATE: \_\_\_\_\_ ZIP: \_\_\_\_\_

PHONE: \_\_\_\_\_ CELL: Building # 5 At EMAIL/FAX: \_\_\_\_\_

PROJECT ADDRESS: 3701 1/2 East 18th Street San, Wa

YEAR BUILT: 1980 TOTAL SF: 4631 CONSTRUCTION TYPE wood, metal, concrete

HOW MANY FLOORS: 2 BASEMENT PRESENT: NO

ROOFING TYPE: AS BUILDING USE PREVIOUS/CURRENT: Resi / Resi

HEATING SYSTEM: electric INSULATION: ATTIC: FG PIPES: Non-Insulated

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
1	Spot white	Kitchen Unit #9	To unit #9 Damaged	1200
2	Spot white	Front Entry Unit #9	To unit #9 Damaged	
3	Spot white	Living Unit #9	To unit #9 Damaged	
4	Spot white	2nd Floor hallway unit #9	To unit #9 Damaged	
5	Spot white	2nd Floor Bedroom on left unit #9	To unit #9 Damaged	
6	Spot white	2nd Floor Bedroom on right unit #9	To unit #9 Damaged	
7	can for for material yellow	Kitchen Unit #9	Damaged	100
8	shu Brown and	Kitchen 2nd level under 1950 floor unit #9	Damaged	200
9	VB Brown Bottom	Bottom level under pergola kitchen unit #9	Damaged	

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280 (503) 221-7904 (360) 254-9385

1-32 are unit 9

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JD1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
10	GWBT <sup>m</sup> white	Kitchen wall unit #9	To unit #9 Damaged	
11	GWBT white	Living room wall unit #9	To unit #9 Damaged	
12	GWBT white	Front entrance unit #9	To unit #9 Damaged	
13	wall ft white	Kitchen wall unit #9	To unit #9 Damaged	
14	wall ft white	Bathroom wall unit #9	To unit #9 Damaged	
15	wall ft white	Living room unit #9	To unit #9 Damaged	
16	GWBT <sup>m</sup> white	2nd Floor wall unit #9	To unit #9 Damaged	
17	GWBT <sup>m</sup> white	2nd Floor Bathroom unit #9	To unit #9 Damaged	
18	GWBT <sup>m</sup> white	2nd Floor Bedroom unit #9	To unit #9 Damaged	
19	wall ft white	2nd Floor Hallway unit #9	To unit #9 Damaged	
20	wall ft white	2nd Floor Bathroom unit #9	To unit #9 Damaged	
21	wall ft white	2nd Floor Bedroom unit #9	To unit #9 Damaged	
22	Insulation Black	ext wall unit #9	Damaged to	
23	Shu Tan	Bathroom unit #9	Damaged	40
24 A	Black CB	Bathroom unit #9	Damaged	40
B	Tan CB			



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # 11170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
25	ceiling bot white	Bathroom Unit #9	Closet Unit #9 2nd Fl Bathroom Unit #9 Damaged	100
26	ceiling bot white	Closet Unit #9	Bathroom Unit #9 2nd Fl Bathroom Unit #9 Damaged	
27	ceiling bot white	2nd Floor Bathroom Unit #9	Bathroom Unit #9 Closet Unit #9 Damaged	
28	shv. white	storage under stairs Unit #9	Damaged	40
29	Insulation white/pink	attic	Damaged	710
30	carpet mastic yellow	2nd Floor under patio Unit #9	Damaged	400
31A B	Brown CB Tan CB floor	2nd Floor Bathroom Unit #9	Damaged	
32	Showers surround Tan	2nd Floor Bathroom Unit #9	Damaged	1
33	combustible material white	Kitchen Unit #10	Damaged	
34	Spaci white	Living Unit #10	10 Unit #10 Damaged	1200
35	Spaci white	Kitchen Unit #10	10 Unit #10 Damaged	
36	Spaci white	Front entry Unit #10	10 Unit #10 Damaged	
37	Spaci white	2nd Floor Hallway Unit #10	10 Unit #10 Damaged	
38	Spaci white	2nd Floor Bedroom on left Unit #10	10 Unit #10 Damaged	
39	Spaci white	2nd Floor Bedroom on right Unit #10	10 Unit #10 Damaged	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JJ 1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
40	wall ft white	Lvr Unit 10	T/O Unit #10 Damaged	
41	wall ft white	Front unit #10	T/O Unit #10 Damaged	
42	wall ft white	Kitchen Unit #10	T/O Unit #10 Damaged	
43	Ceiling white	Lvr wall unit #10	T/O Unit #10 Damaged	
44	Ceiling white	Bathroom wall Unit #10	T/O Unit #10 Damaged	
45	Ceiling white	Kitchen wall Unit #10	T/O Unit #10 Damaged	
46	wall ft white	Lvr Unit #10	T/O Unit #10 Damaged	
47	wall ft white	Bathroom Unit #10	T/O Unit #10 Damaged	
48	wall ft white	Kitchen Unit #10	T/O Unit #10 Damaged	
49	Ceiling white	2nd Floor Hallway Unit #10	T/O Unit #10 Damaged	
50	Ceiling white	2nd Floor Bathroom Ceiling Unit #10	T/O Unit #10 Damaged	
51	Ceiling white	2nd Floor Bedroom Ceiling Unit #10	T/O Unit #10 Damaged	
52	Insulation Blue	ext wall Unit #10	Damaged XO	
53	Vt Gray Top	Pl. floor Top Layer Unit #10	Damaged	200
54	Vt Brown Bottom	Pl. floor Bottom Layer Unit #10	Damaged	1

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # U 1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
55	VT Tan	Bathroom Unit #10	Damaged	40
56 A B	White CB Tan CBM	Bathroom Unit #10	Damaged	40L
57	ceiling bt white	Bathroom Unit #10	2nd Fl Bathroom Unit #10 Closet Unit #10 Damaged	100
58	ceiling bt white	2nd Fl Bathroom Unit #10	Bathroom Unit #10 Closet Unit #10 Damaged	
59	ceiling bt white	closet Unit #10	Bathroom Unit #10 2nd Fl Bathroom Unit #10 Damaged	
60	Insulation blue / white	attic	Damaged 7/10	
61	Shw Tan	2nd Fl Bathroom Unit #10	Damaged	40
62	Wire Insulation Grey	attic	Damaged 4/10	
63	Spact white	Live Unit #11	7/10 Unit #11 Damaged	1200
64	Spact white	Front entry Unit #11	7/10 Unit #11 Damaged	
65	Spact white	Kitchen Unit #11	7/10 Unit #11 Damaged	
66	Spact white	2nd Floor Hallway Unit #11	7/10 Unit #11 Damaged	
67	Spact white	2nd Floor Bedroom on left Unit #11	7/10 Unit #11 Damaged	
68	Spact white	2nd Floor Bedroom Right Unit #11	7/10 Unit #11 Damaged	
69	Unit 3 in white	Live wall Unit #11	7/10 Unit #11 Damaged	



# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JJ1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
70	Leads on white	Kitchen wall Unit #11	Flt Unit #11 Damaged	
71	Leads on white	Bathroom Unit #11 wall	Flt Unit #11 Damaged	
72	wall for white	Living Unit #11	Flt Unit #11 Damaged	
73	wall for white	Kitchen Unit #11	Flt Unit #11 Damaged	
74	wall for white	Bathroom Unit #11	Flt Unit #11 Damaged	
75	Leads on white	2nd Floor hall ceiling Unit #11	Flt Unit #11 Damaged	
76	Leads on white	2nd Floor Bathroom Unit #11 ceiling	Flt Unit #11 Damaged	
77	Leads on white	2nd Floor Bedroom left Unit #11 ceiling	Flt Unit #11 Damaged	
78	wall for white	2nd Floor hallway Unit #11	Flt Unit #11 Damaged	
79	wall for white	2nd Floor Bathroom Unit #11	Flt Unit #11 Damaged	
80	wall for white	2nd Floor Bedroom on left Unit #11	Flt Unit #11 Damaged	
81	Insulation Block	ext wall	Damaged Flt	
82	circumfer to G-Fan / long	Kitchen ceiling fan Unit #11	2nd Floor Bathroom Unit #11 Damaged	
83	Sh- Brown red	Kitchen 2nd layer under pers Unit #11	Damaged	200
84	vs Brown Bottom	Kitchen Bottom layer under pers Unit #11	Damaged	



# ♦ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ♦

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JS1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
85	Shu Tan	Bathroom unit #11	Damaged	40
86	ceiling txt white	Bathroom unit #11	closet unit #11 2nd Floor Bathroom unit #11 Damaged	100
87	ceiling txt white	closet unit #11	Bathroom unit #11 2nd Fl Bathroom unit #11 Damaged	
88	ceiling txt white	2nd Floor Bathroom unit #11	Bathroom unit #11 Closet unit #11 Damaged	
89	Insulation pink white	aspr	7/0	
90	Spout white	LVR unit #12	T/O unit #12	1200
91	Spout white	Front unit entry #12	T/O unit #12	
92	Spout white	Kitchen unit #12	T/O unit #12	
93	Spout white	2nd Floor hallway unit #12	T/O unit #12	
94	Spout white	2nd Floor Bedroom unit #12	T/O unit #12	
95	Spout white	2nd Floor Bedroom unit #12	T/O unit #12	
96	wall txt white	Front entry unit #12	T/O unit #12	
97	wall txt white	CL unit #12	T/O unit #12	
98	wall txt white	Kitchen unit #12	T/O unit #12	
99	wall txt white	hallway unit #12	T/O unit #12	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280

(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # 55-1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
100	wall fxt white	2nd Floor Bedroom on left unit #12		
101	wall fxt white	2nd Floor Bedroom on right unit #12		
102	Curb on white	Front entry wall unit #12	T/O unit #12	
103	Curb on white	2nd Floor wall unit #12	T/O unit #12	
104	Curb on white	Kitchen unit #12 wall	T/O unit #12	
105	Curb on white	2nd Floor hallway unit #12	T/O unit #12	
106	Curb on white	2nd Floor Bathroom unit #12	T/O unit #12	
107	Curb on white	2nd Floor Bedroom on left unit #12	T/O unit #12	
108	Shu- Brown	Kitchen Top layer unit #12		200
109	1-3 Brown	Kitchen Bottom unit #12		
110	ceramic tile G-Tan	Kitchen unit #12		100
111	ceramic tile G-Grey	2nd Floor Bathroom unit #12		100
112	ceiling fxt white	2nd Floor Bathroom unit #12	Bathroom unit #12 Closet unit #12	700
113	ceiling fxt white	Bathroom unit #12	2nd Fl Bathroom unit #12 Closet unit #12	
114	ceiling fxt white	closet unit #12	2nd Fl Bathroom unit #12 Bathroom unit #12	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JJ1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
115	Insulation Blue	ext wall unit 12	T/O	
116	Insulation pink/white	attic unit 12	T/O	
117	ceiling tile white	Living Room unit 13		200
118	ceiling tile white	Living Room unit 13		
119	ceiling tile white	Living Room unit 13		
120	spout white	Kitchen unit #13	ST/O unit #13	800
121	spout white	2nd Floor Hallway unit #13	ST/O unit #13	
122	spout white	2nd Floor Bedroom unit #13	ST/O unit #13	
123	ceiling tile white	Bathroom unit #13	Closet unit #13 2nd Fl Bathroom unit 13	300
124	ceiling tile white	Closet unit #13	Bathroom unit #13 2nd Fl Bathroom unit #13	
125	ceiling tile white	2nd Floor Bathroom unit 13	Bathroom unit 13 Closet unit #13	
126	ceiling tile white	Kitchen unit #13	T/O unit #13	
127	ceiling tile white	ext wall unit #13	T/O unit #13	
128	ceiling tile white	Front entry wall unit 13	T/O unit #13	
129	ceiling tile white	2nd floor hall unit 13	T/O unit #13	

# ❖ CERTIFIED ENVIRONMENTAL CONSULTING, LLC. ❖

615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

## SURVEY SAMPLE FORM

LAB # JJ1170

SAMPLE #	DESCRIPTION OF MATERIAL	SAMPLE LOCATION	HOMOGENEOUS AREA	SQ FOOTAGE
130	Cer B <sup>ts</sup> wht	2nd floor unit 13 Bathroom ceiling	T/O unit 13	
131	Cer B <sup>ts</sup> white	2nd floor unit 13 ceiling Bedroom on Right	T/O unit 13	
132	Wall test wht	Unit #13	T/O unit #13	
133	Wall test wht	Front entry unit 13	T/O unit #13	
134	Wall test wht	Bathroom unit #13	T/O unit #13	
135	Wall test white	2nd floor hallway unit 13	T/O unit #13	
136	Wall test white	2nd floor Bathroom unit #13	T/O unit #13	
137	Wall test white	2nd floor unit #13 Bedroom on Right	T/O unit #13	
138	Insulating Black	exterior	T/O	
139	Counter top yellow	Kitchen unit 13		
140	Sho Backing white 2nd floor	Kitchen under pers unit 13		200
141	White sheet vinyl	Top layer unit 13 Bathroom	Closet unit 13	80
142	UB Brown	Bottom layer Bathroom unit 13		100
143	Sho Backing white 2nd	Front entry under pers unit 13		40
144	Orange by Tan	2nd floor Bathroom unit 13 top layer		50



615 SE CHKALOV DRIVE SUITE 12, VANCOUVER, WASHINGTON 98683-5280  
(503) 221-7904 PHONE (360) 254-9385 AND FAX-(360) 891-9633

LAB # JJ 1170

[illegible]



**January 2, 2025**

**Date Park Condominiums**

**3701 House Basement:** Remove and dispose of approximately 200 linear feet of asbestos containing duct seam tape.

**Office, Unit 1,2,3:** Remove and dispose of approximately 2,500 square feet of asbestos containing ceiling texture (Popcorn Scrape),

**Units 4,6,7,8:** Remove and dispose of approximately 3,000 square feet of asbestos containing ceiling texture (Popcorn Scrape)

**Unit 7:** Remove and dispose of approximately 135 square feet of asbestos containing sheet vinyl and wood underlayment.

**Units 9,11,12,13:** Remove and dispose of approximately 3,000 square feet of asbestos containing ceiling texture (Popcorn Scrape),

**Unit 10:** Remove and dispose of approximately 800 square feet of asbestos containing ceiling texture (Popcorn Demo Fire Clean-up).

**Unit 9,11,13:** Remove and dispose of approximately 260 square feet of asbestos containing sheet vinyl and wood underlayment from kitchens